

EUROCRAFT INDUSTRIES INC.

SERIES 600 COMMERCIAL DOOR

(HVHZ)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC) INCLUDING HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - ASTM E283-04
 - ASTM E331-00(09)
 - ASTM E1886-13a
 - ASTM E1996-14a
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN HVHZ AREAS.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. WINDOW FRAME MATERIAL: ALUMINUM 6063-T5 & 6063-T6
8. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 2 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	DESCRIPTION
1	GENERAL NOTES
2	GLAZING DETAILS
3	ELEVATIONS (10')
4	ELEVATIONS (10' WITH TRANSOM)
5	ELEVATIONS (8')
6	ELEVATIONS(8' WITH TRANSOM)
7	VERTICAL SECTIONS
8	HORIZONTAL SECTIONS
9	HORIZONTAL SECTIONS
10	HARDWARE OPTIONS
11	MULLION LOAD JAMB CAPACITY
12	INSTALLATION NOTES AND ANCHOR DETAILS
13	BILL OF MATERIALS
14	COMPONENTS

DESIGN PRESSURE RATING		
GLAZING TYPE	MAX DESIGN PRESSURE	MISSILE RATING
G-1,G-2,G-3 & G-4	SEE SHEET 3-6 FOR DESIGN PRESSURE TABLE	LARGE & SMALL IMPACT



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871FX: (305) 713-1872


TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)
GENERAL NOTES

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

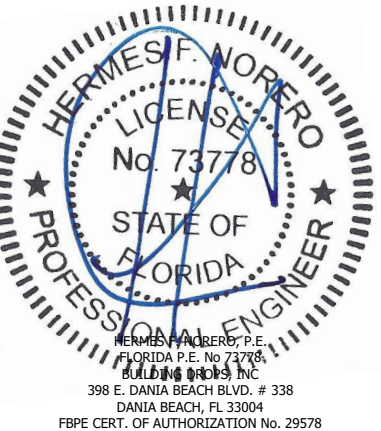

FL #:
FL38771

DATE:
06.14.21

DWG. BY:
ER


CHK. BY:
HFN

SCALE:
NTS

DWG. #:
ECI030


SHEET:
1

OF 14

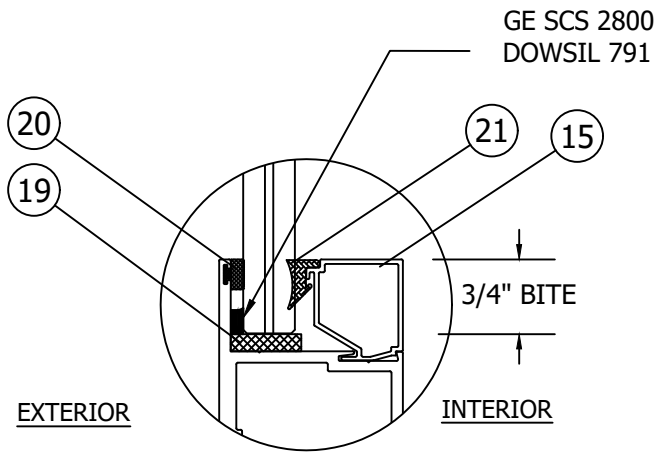


GLAZING DETAIL 1

GLASS TYPE 1:
9/16" LAMINATED GLASS:
1/4" HEAT STRENGTHENED GLASS
0.090" TROFISOL PVB INTERLAYER BY KURARAY OF AMERICA
1/4" HEAT STRENGTHENED GLASS

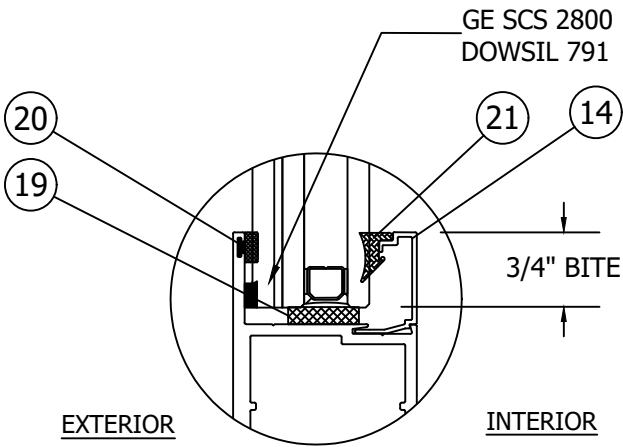


GLAZING DETAIL 3

GLASS TYPE 3:
1 3/16" INSULATED LAMINATED GLASS:
3/16" HEAT STRENGTHENED GLASS
0.090" TROFISOL PVB INTERLAYER BY KURARAY OF AMERICA
3/16" HEAT STRENGTHENED GLASS
1/2" AIR SPACE
1/4" TEMPERED GLASS

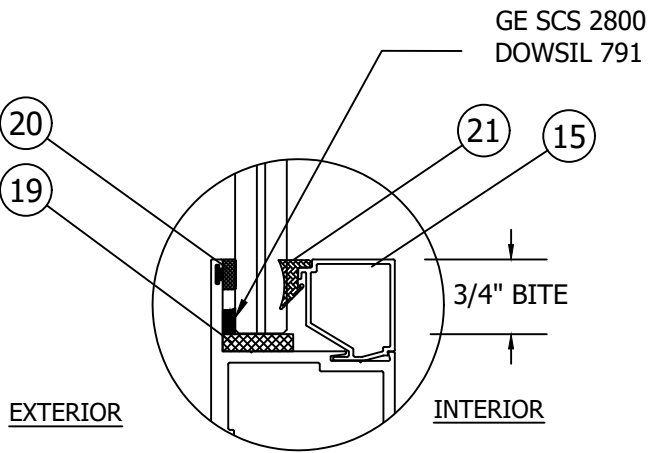

GLAZING DETAIL 2

GLASS TYPE 2:
9/16" LAMINATED GLASS:
1/4" HEAT STRENGTHENED GLASS
0.090" SG INTERLAYER BY KURARAY OF AMERICA
1/4" HEAT STRENGTHENED GLASS

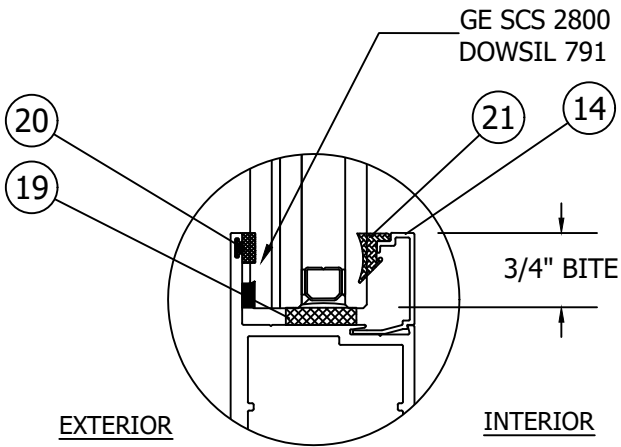

GLAZING DETAIL 4

GLASS TYPE 4:
1 3/16" INSULATED LAMINATED GLASS:
3/16" HEAT STRENGTHENED GLASS
0.090" SG INTERLAYER BY KURARAY OF AMERICA
3/16" HEAT STRENGTHENED GLASS
1/2" AIR SPACE
1/4" TEMPERED GLASS

- GLAZING NOTES:
1. GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS.
 2. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 3. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 4. GLASS TYPE SHALL COMPLY WITH APPLICABLE GLAZING REQUIREMENTS PER CHAPTER 24 OF THE FBC




7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871FX: (305) 713-1872

TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)
GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)390-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

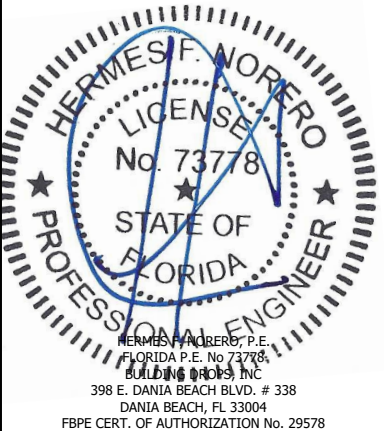

FL #:
FL38771

DATE: **06.14.21**

DWG. BY: **ER** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ECI030**

SHEET:

2

**TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)**


ELEVATIONS (10')

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004



REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

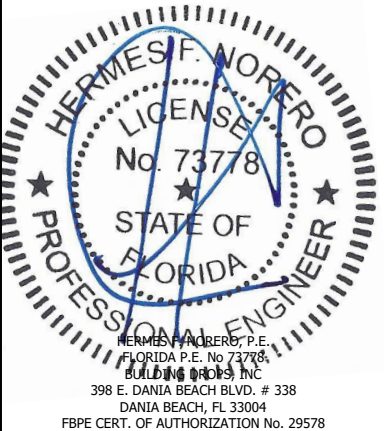

FL #:

FL38771

DATE: 06.14.21

DWG. BY: ER	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: ECI030

SHEET:


3

OF 14

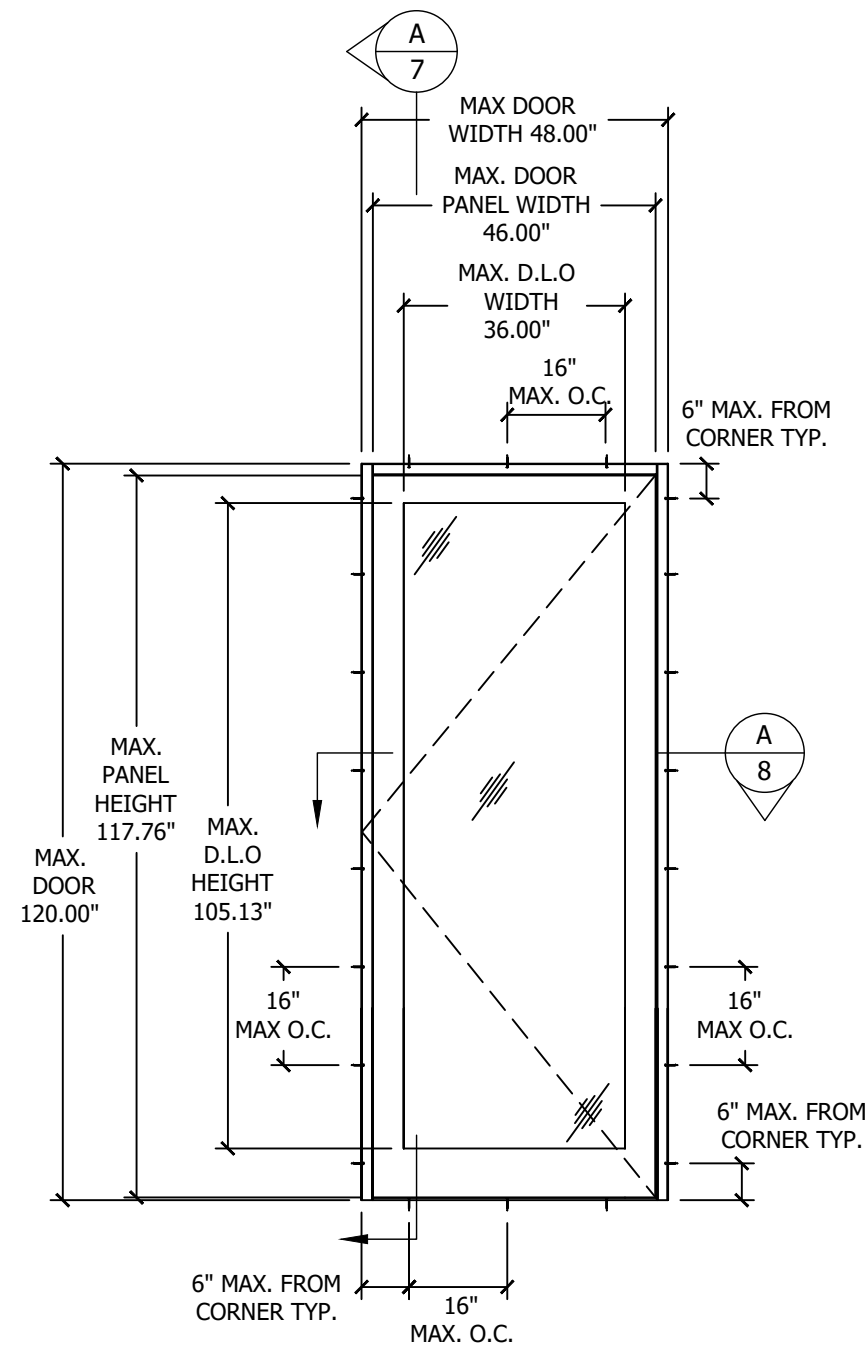

ELEVATION

DESIGN PRESSURE RATING		GLAZING OPTIONS G2, G4
POSITIVE	+120 PSF	
NEGATIVE	-120 PSF	
WITH ASTRAGAL REINFORCEMENT ITEM #16		

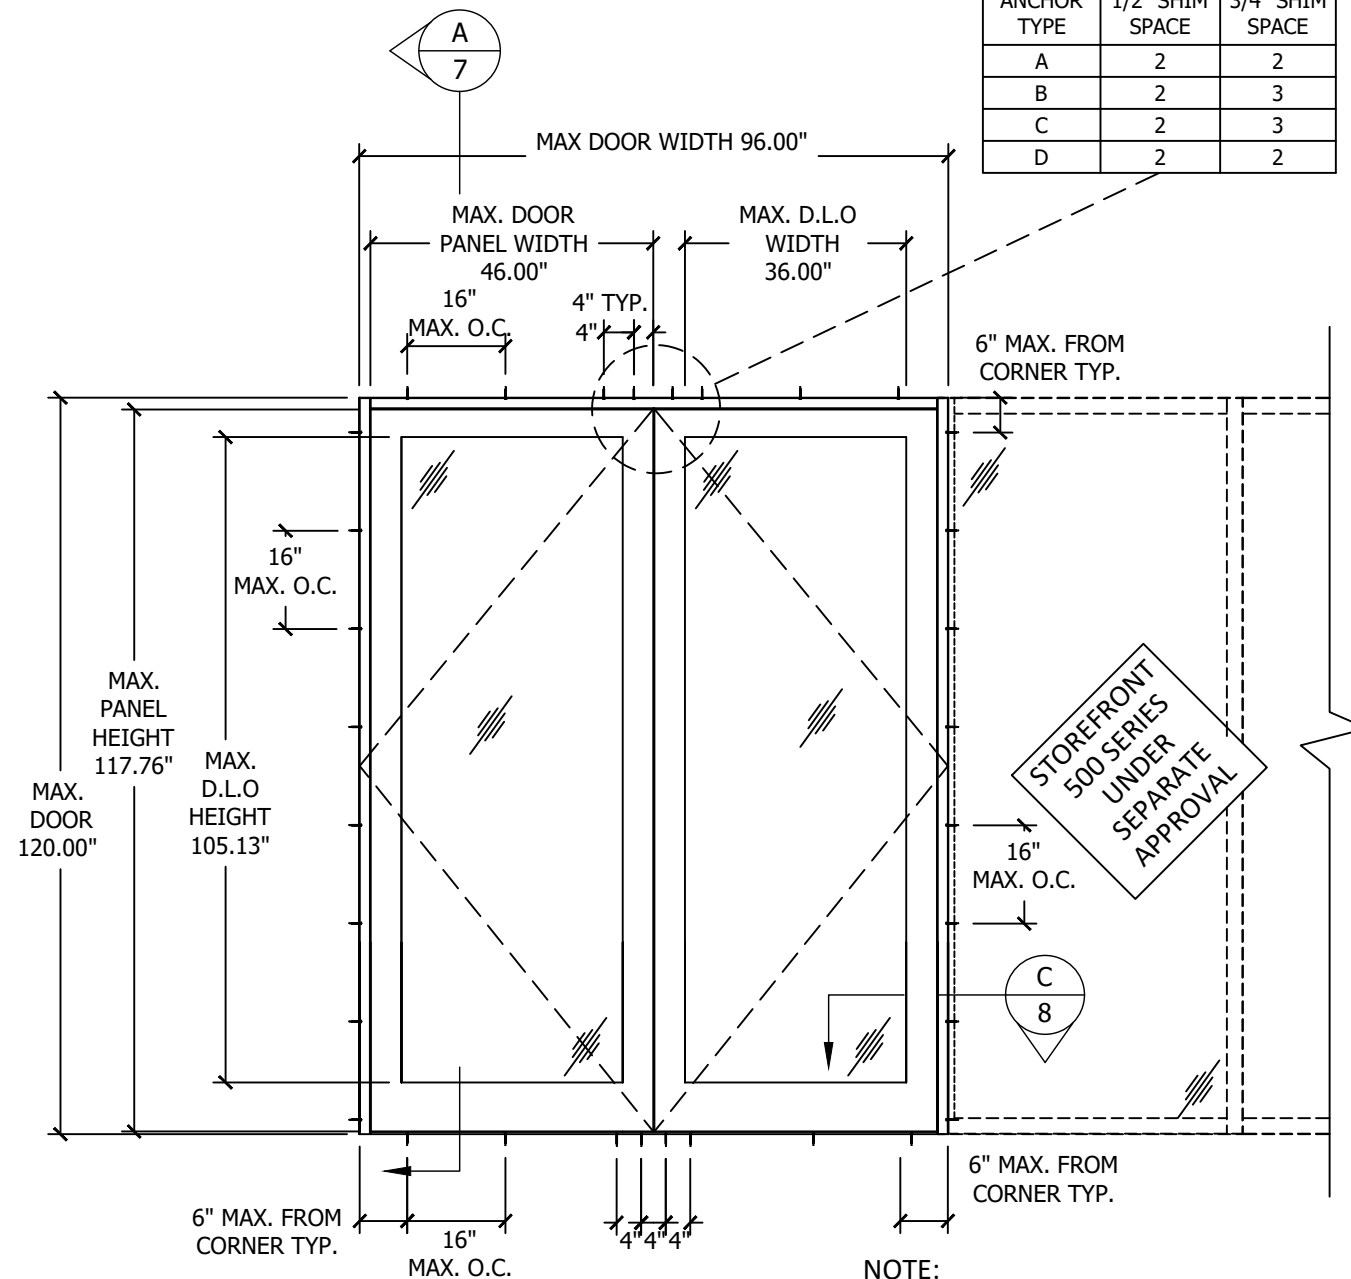

ELEVATION


NOTE:
STOREFRONT 500 SERIES APPLICABLE
FOR BOTH SINGLE & DOUBLE DOORS

NO. OF ADDITIONAL ANCHORS AT ASTRAGAL ENDS		
ANCHOR TYPE	1/2" SHIM SPACE	3/4" SHIM SPACE
A	2	2
B	2	3
C	2	3
D	2	2


ABREVIATIONS:

D.L.O.	DAYLITE OPENING.
F.H.	FRAME HEIGHT.
F.W.	FRAME WIDTH.
D.O.	DOOR OPENING
W/	WITH
W/O	WITHOUT
O.C.	ON CENTER

s:\projects\eurocraft industries inc\bc-21-1156.1 - fbc submittal - f138771 series 600 os commercial door.dwg\eci030.dwg 9/19/2022 3:28 PM

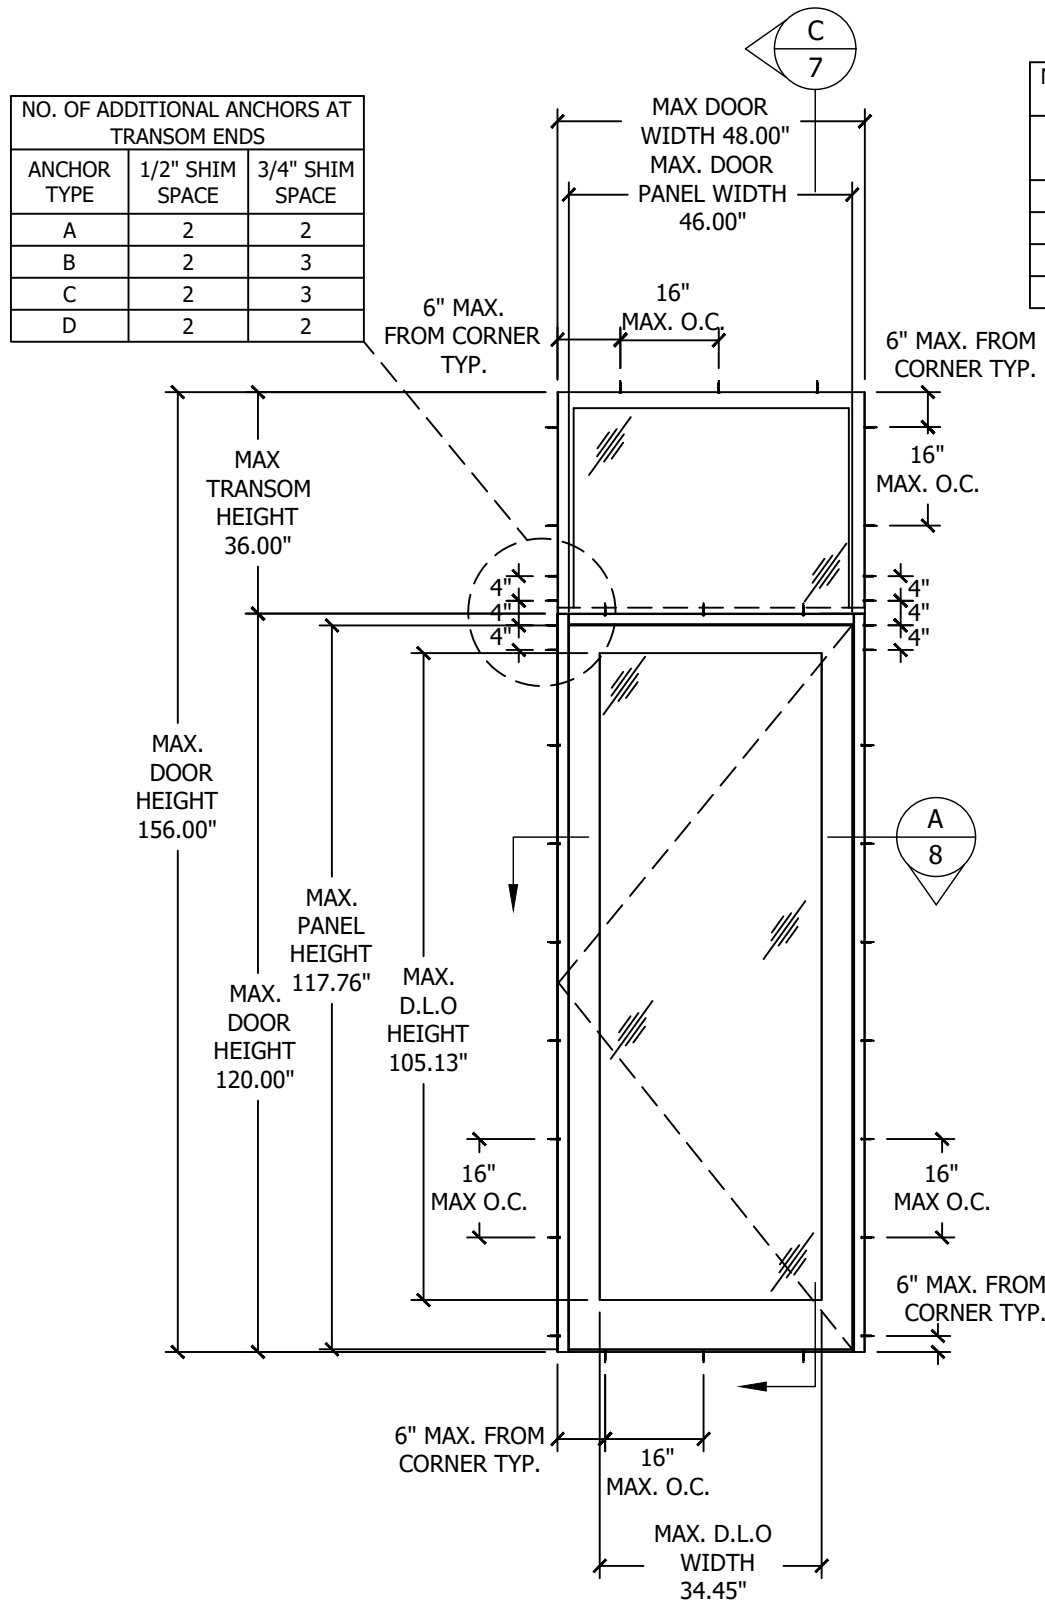

ELEVATION

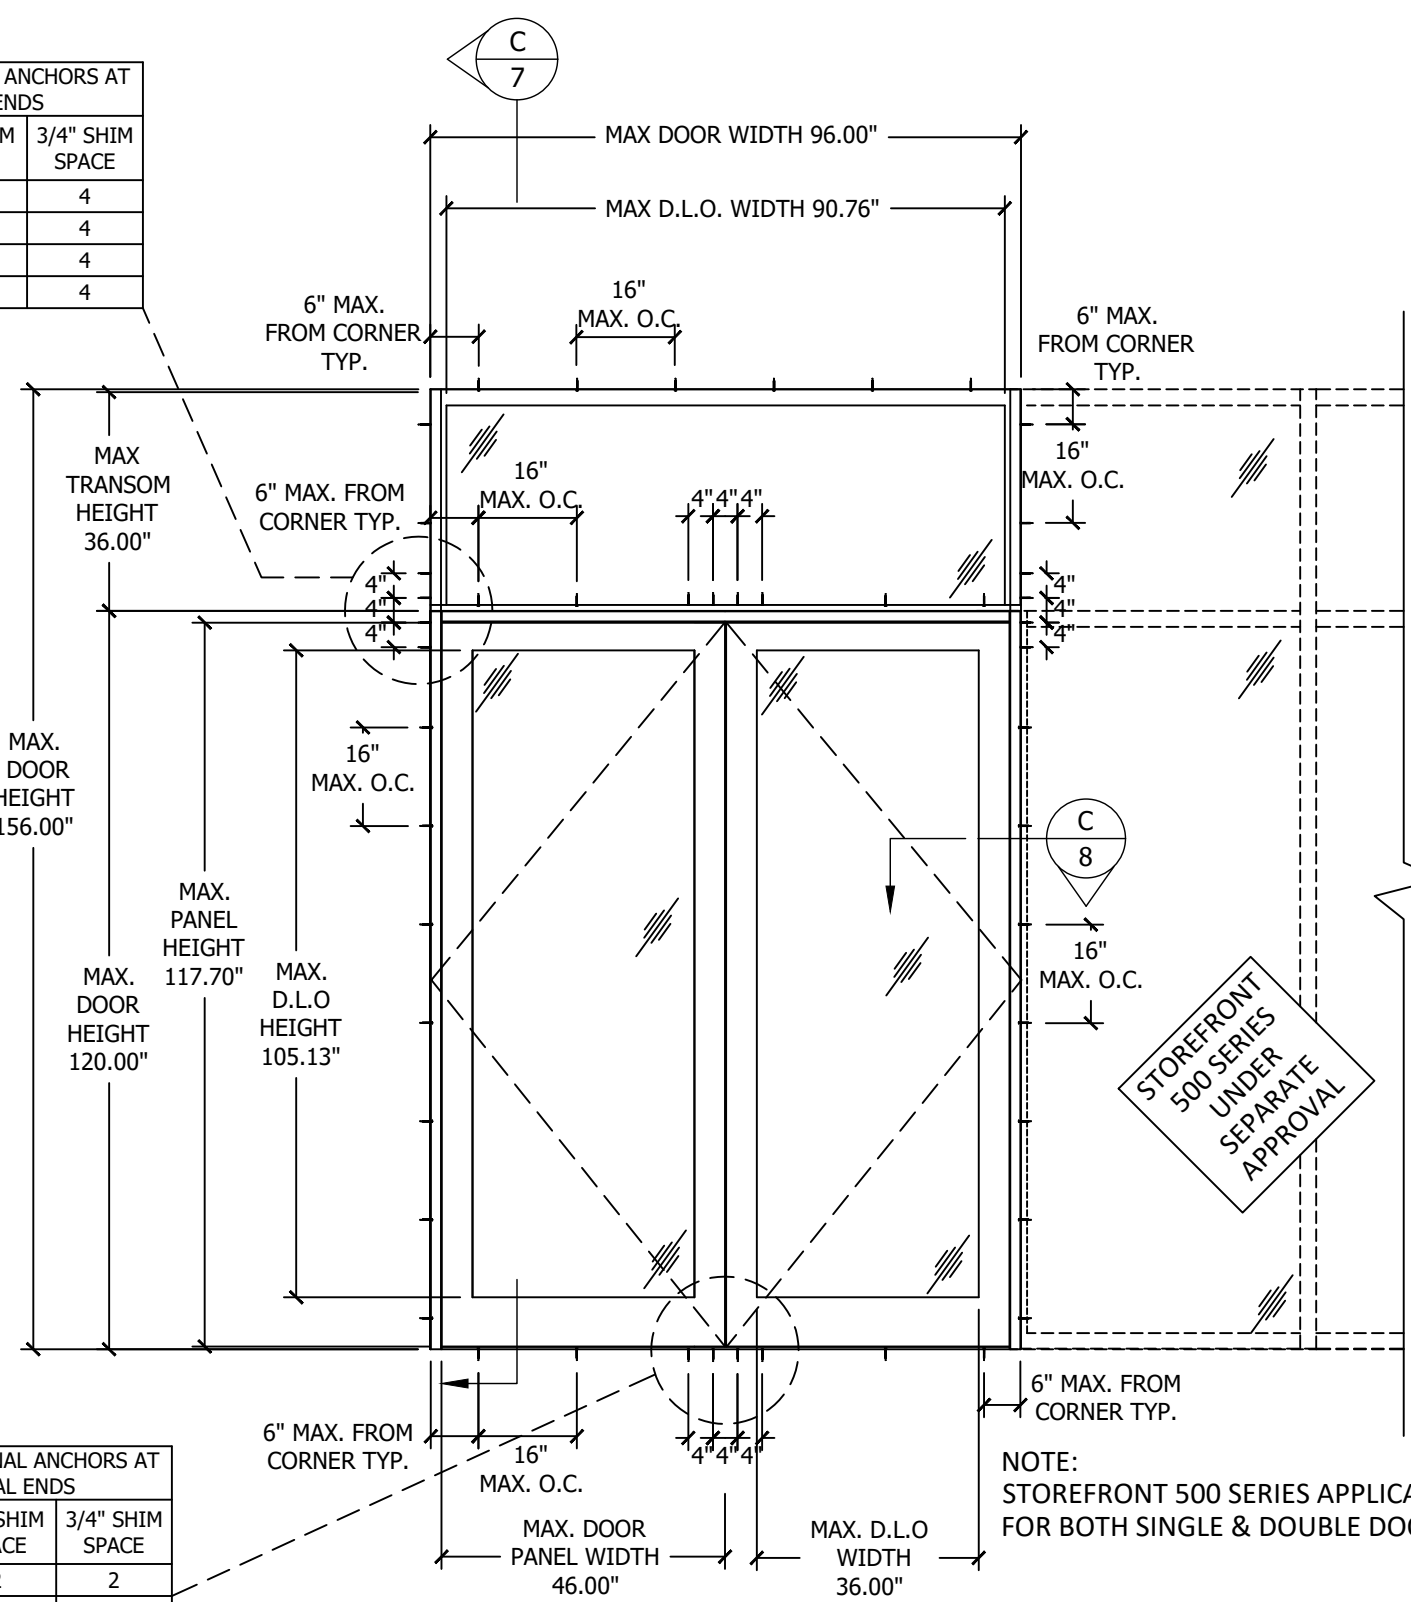

ELEVATION

NOTE:
STOREFRONT 500 SERIES APPLICABLE
FOR BOTH SINGLE & DOUBLE DOORS

ABBREVIATIONS:

D.L.O.	DAYLITE OPENING.
F.H.	FRAME HEIGHT.
F.W.	FRAME WIDTH.
D.O.	DOOR OPENING
W/	WITH
W/O	WITHOUT
O.C.	ON CENTER

7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871FX: (305) 713-1872

TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)

ELEVATIONS (10' WITH TRANSOM)

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSED PROFESSIONAL ENGINEER
No. 73778
STATE OF FLORIDA
HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL38771

DATE: 06.14.21

DWG. BY: ER	CHK. BY: HFN
-------------	--------------


SCALE: NTS

DWG. #: ECI030

SHEET: 4

OF 14


s:\projects\eurocraft industries inc\bc-21-1156.1 - fbc submittal - f138771-series 600 os commercial door.dwg\ec030.dwg 9/19/2022 3:28 PM

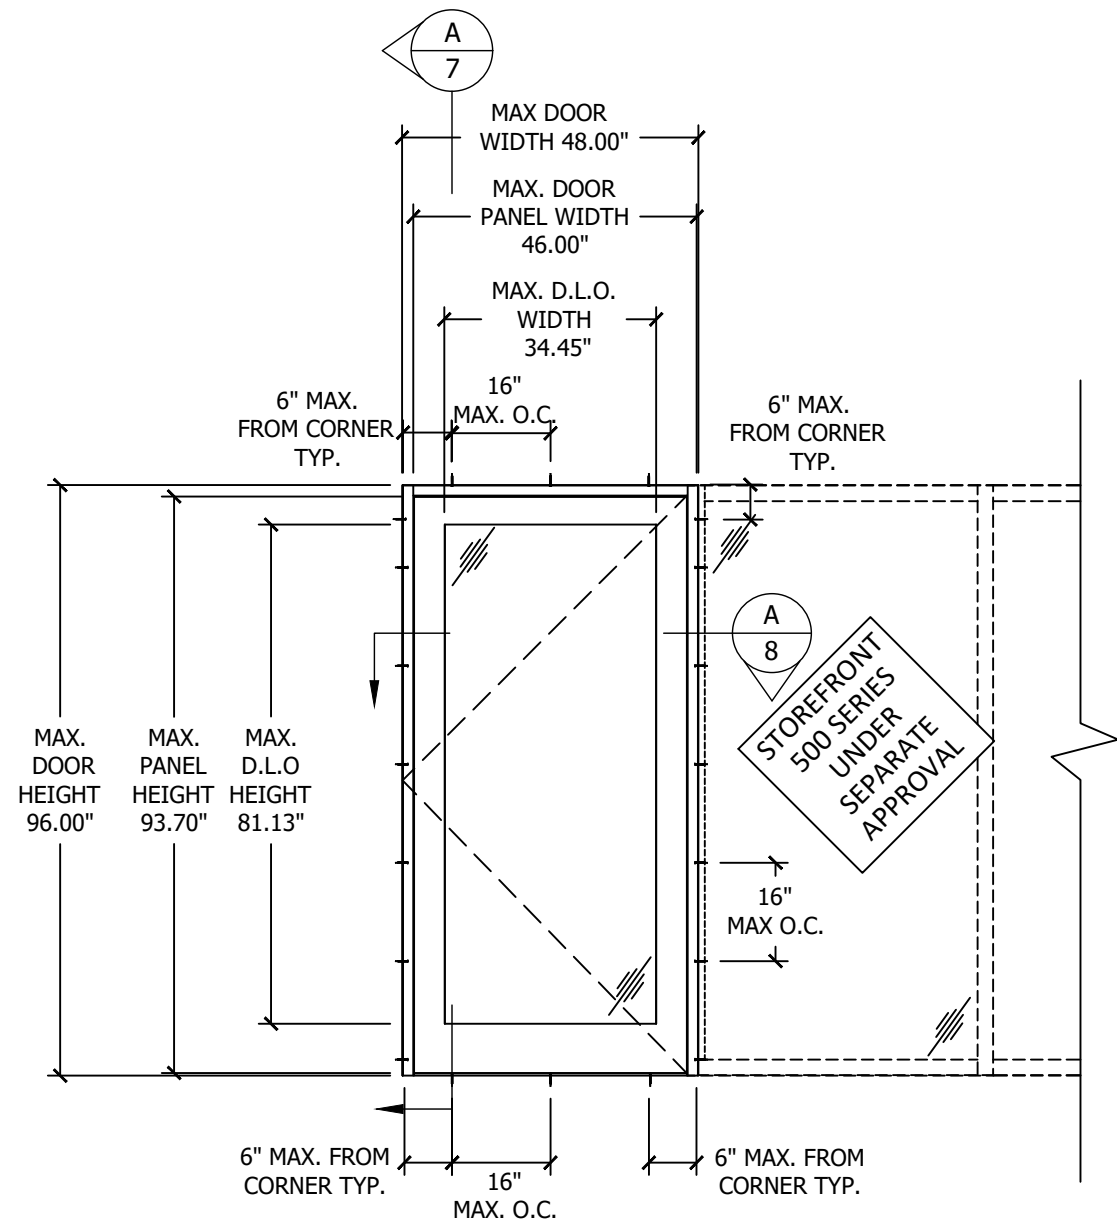

ELEVATION

NOTE:
STOREFRONT 500 SERIES APPLICABLE
FOR BOTH SINGLE & DOUBLE DOORS

NO. OF ADDITIONAL ANCHORS AT ASTRAGAL STILE ENDS		
ANCHOR TYPE	1/2" SHIM SPACE	3/4" SHIM SPACE
A	2	2
B	2	3
C	2	3
D	2	2

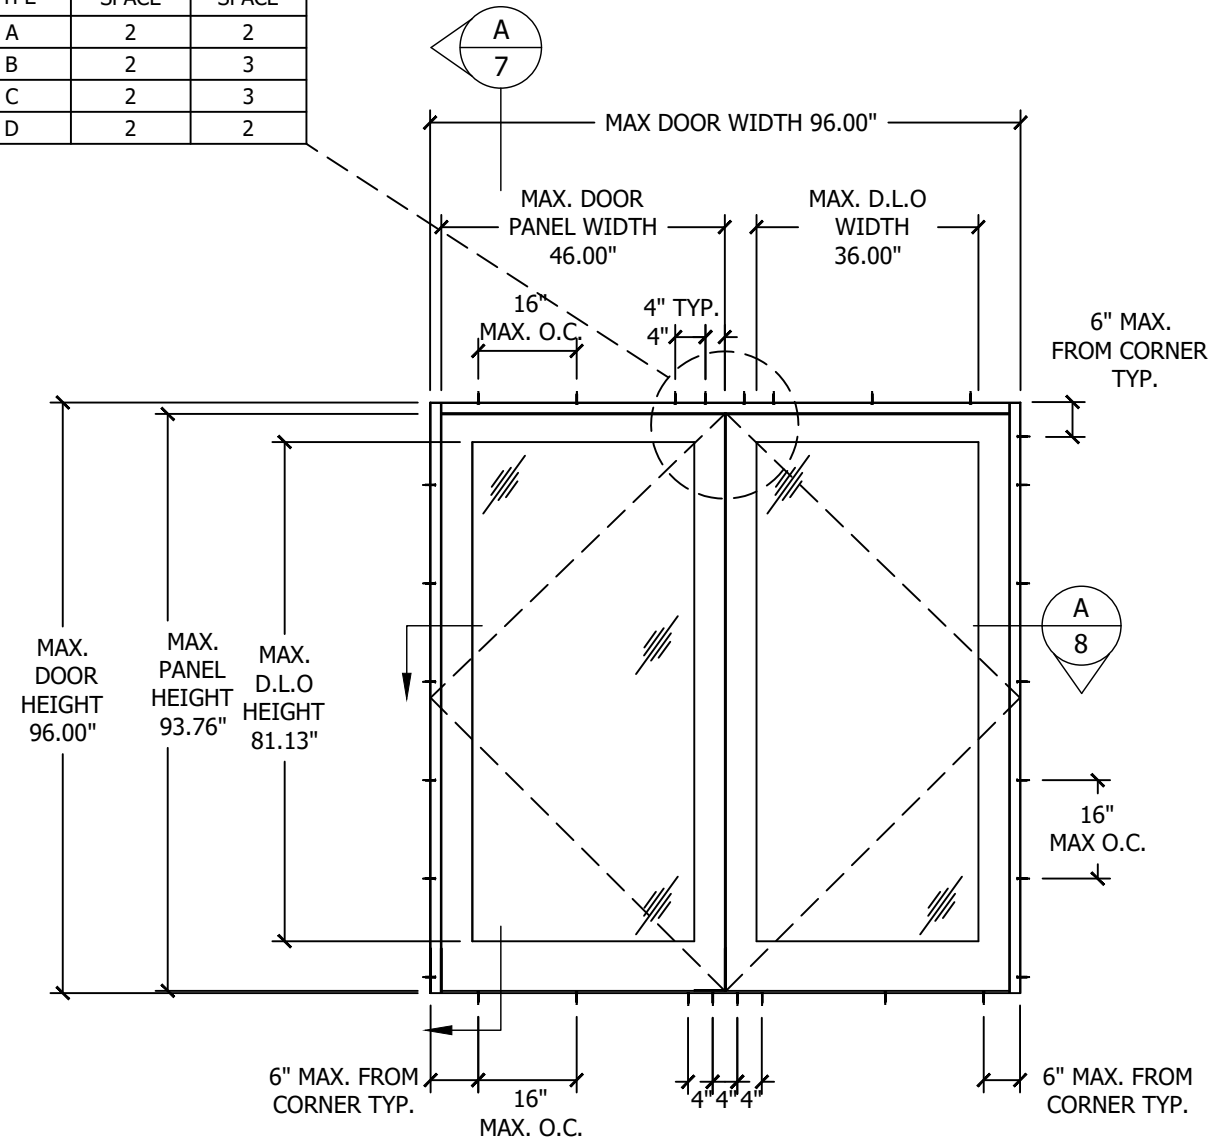

ELEVATION

DESIGN PRESSURE RATING		GLAZING OPTIONS
POSITIVE	+140 PSF	
NEGATIVE	-140 PSF	G1 , G2 , G3 , G4
WITHOUT ASTRAGAL REINFORCEMENT ITEM #16		

ABBREVIATIONS:

D.L.O.	DAYLITE OPENING.
F.H.	FRAME HEIGHT.
F.W.	FRAME WIDTH.
D.O.	DOOR OPENING
W/	WITH
W/O	WITHOUT
O.C.	ON CENTER



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871FX: (305) 713-1872


TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)
ELEVATIONS (8')

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

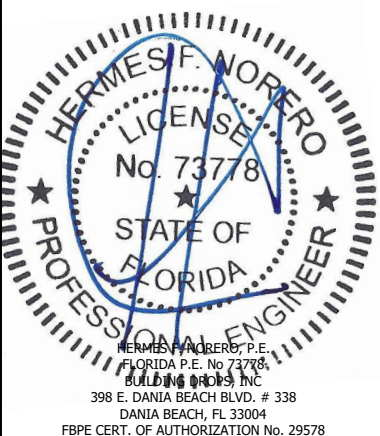

FL #:

FL38771

DATE: 06.14.21

DWG. BY: ER
CHK. BY: HFN

SCALE: NTS

DWG. #: ECI030

SHEET:

5

TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)

ELEVATIONS (8' WITH TRANSOM)

PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338


DANIA BEACH, FL 33004
PH: (954)399-8478

FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC PROJECT SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED PROFESSIONAL ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

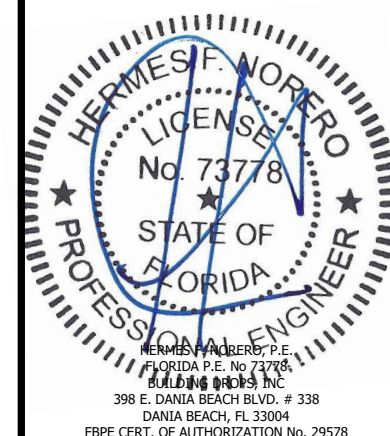

FL #:

FL38771

DATE: 06.14.21

DWG. BY:
ER

CHK. BY:
HFN


SCALE: NTS

DWG. #: ECI030

SHEET:


6

OF 14

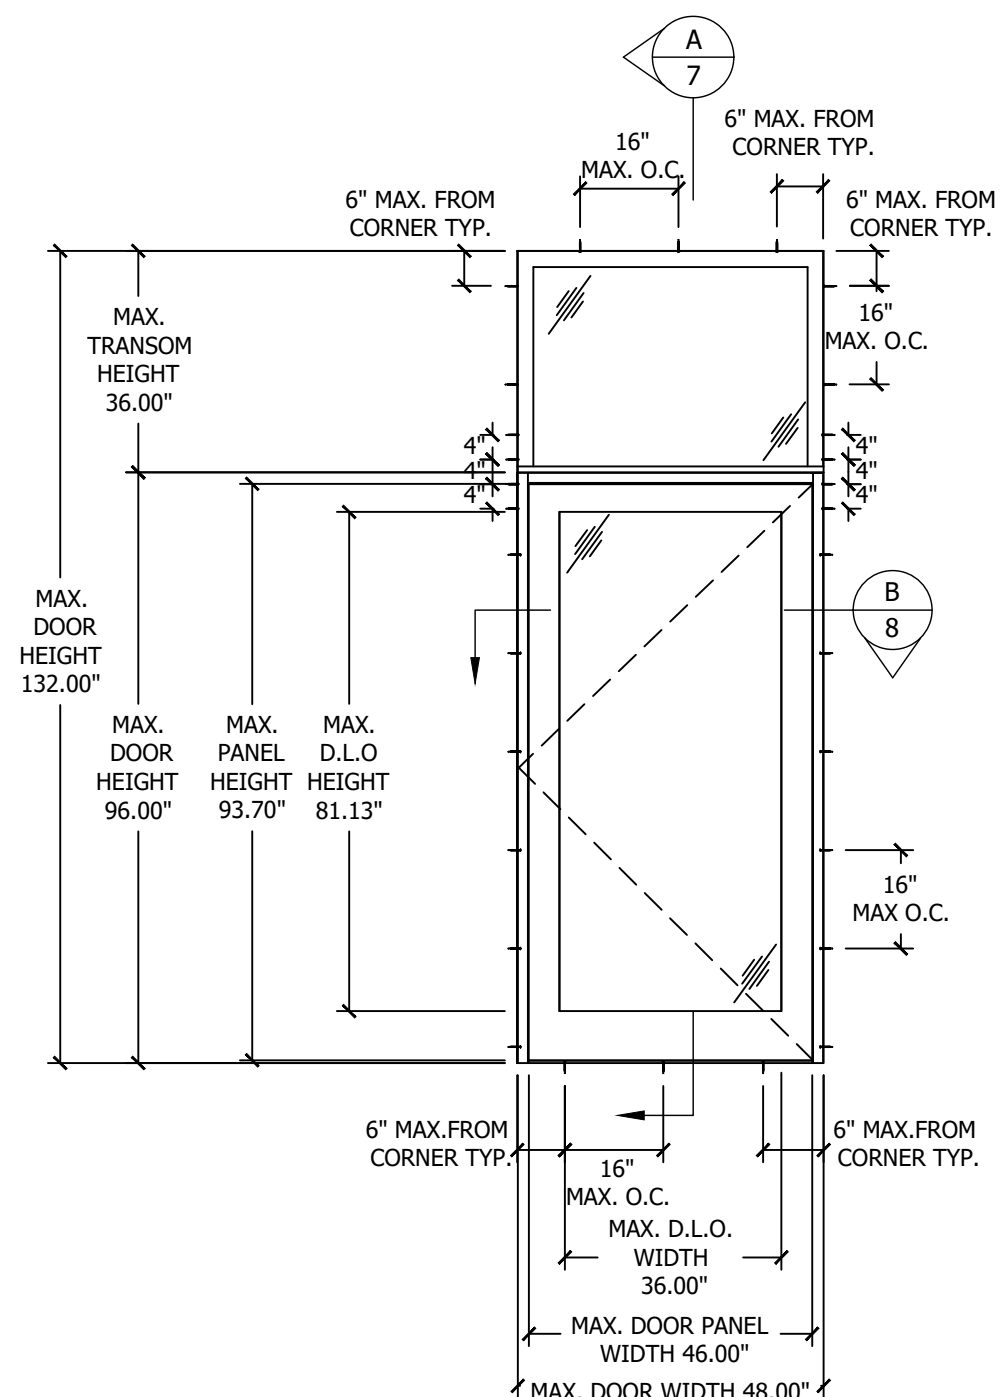

ELEVATION

DESIGN PRESSURE RATING		GLAZING OPTIONS G1 , G2 , G3 , G4
POSITIVE	+140 PSF	
NEGATIVE	-140 PSF	
WITHOUT ASTRAGAL REINFORCEMENT ITEM #16		

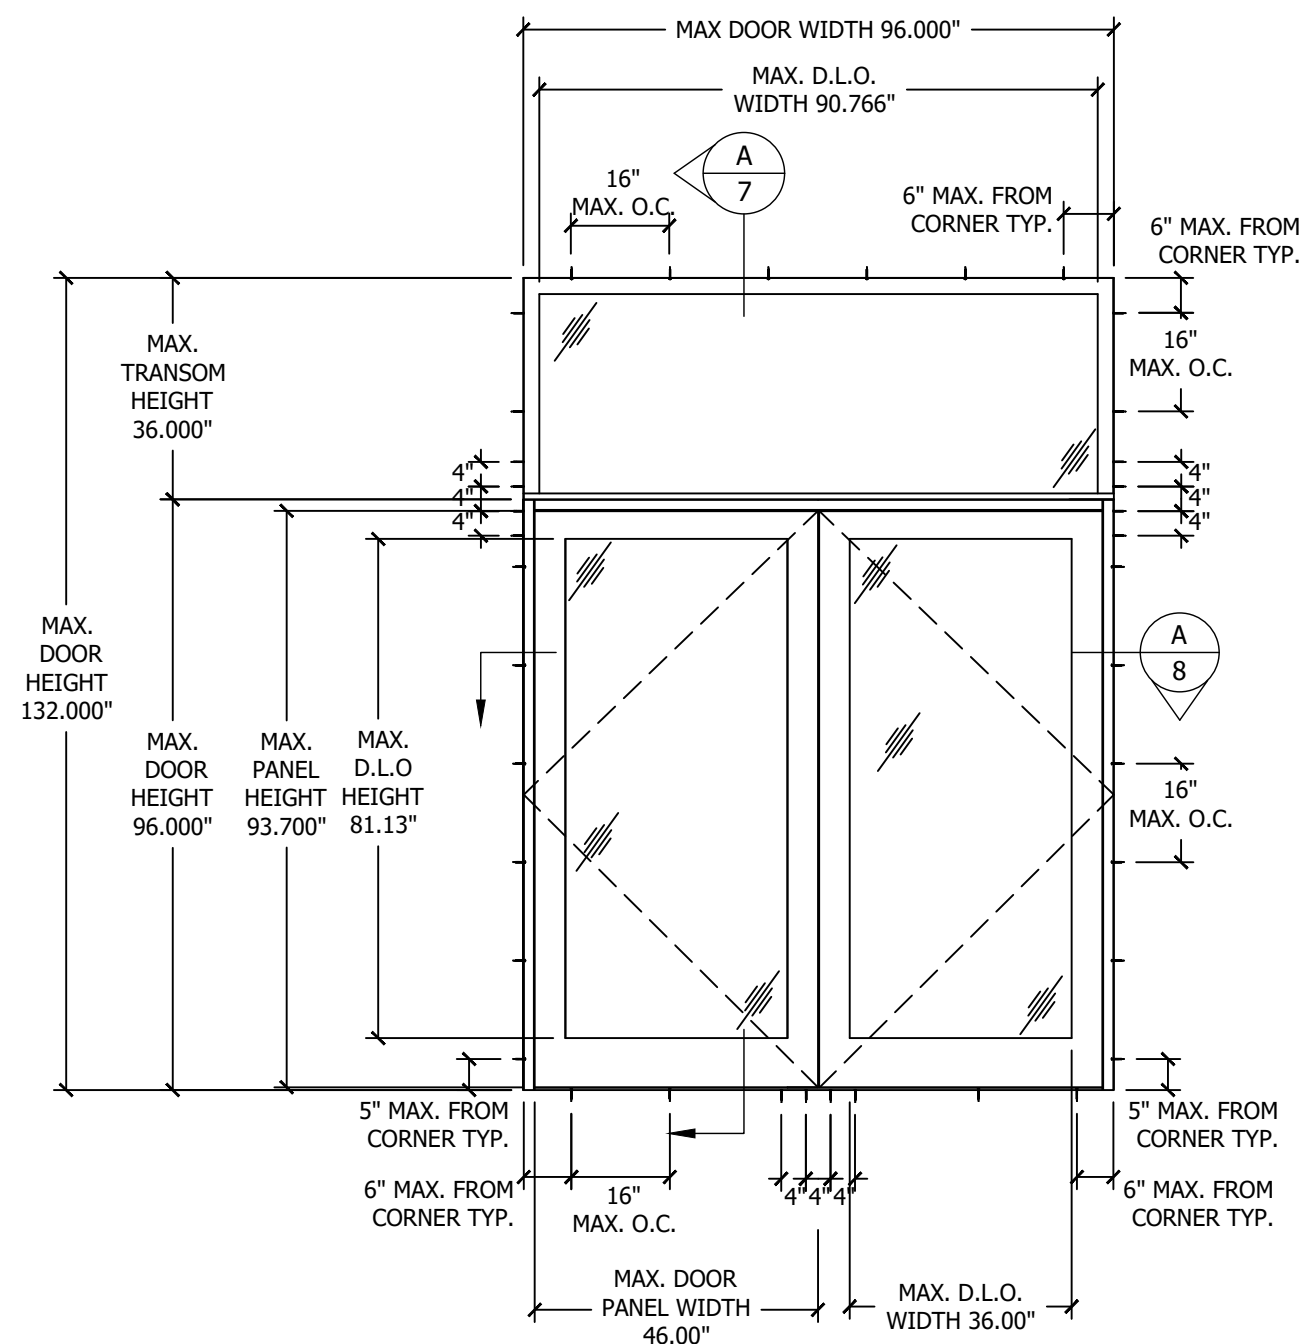


ELEVATION


ABREVIATIONS:

D.L.O.	DAYLITE OPENING.
F.H.	FRAME HEIGHT.
F.W.	FRAME WIDTH.
D.O.	DOOR OPENING
W/	WITH
W/O	WITHOUT
O.C.	ON CENTER


s:\projects\eurocraft industries inc\bc-21-1156.1 - fbc submittal - f138771-series 600 os commercial door\dwgs\eci030.dwg 9/19/2022 3:28 PM

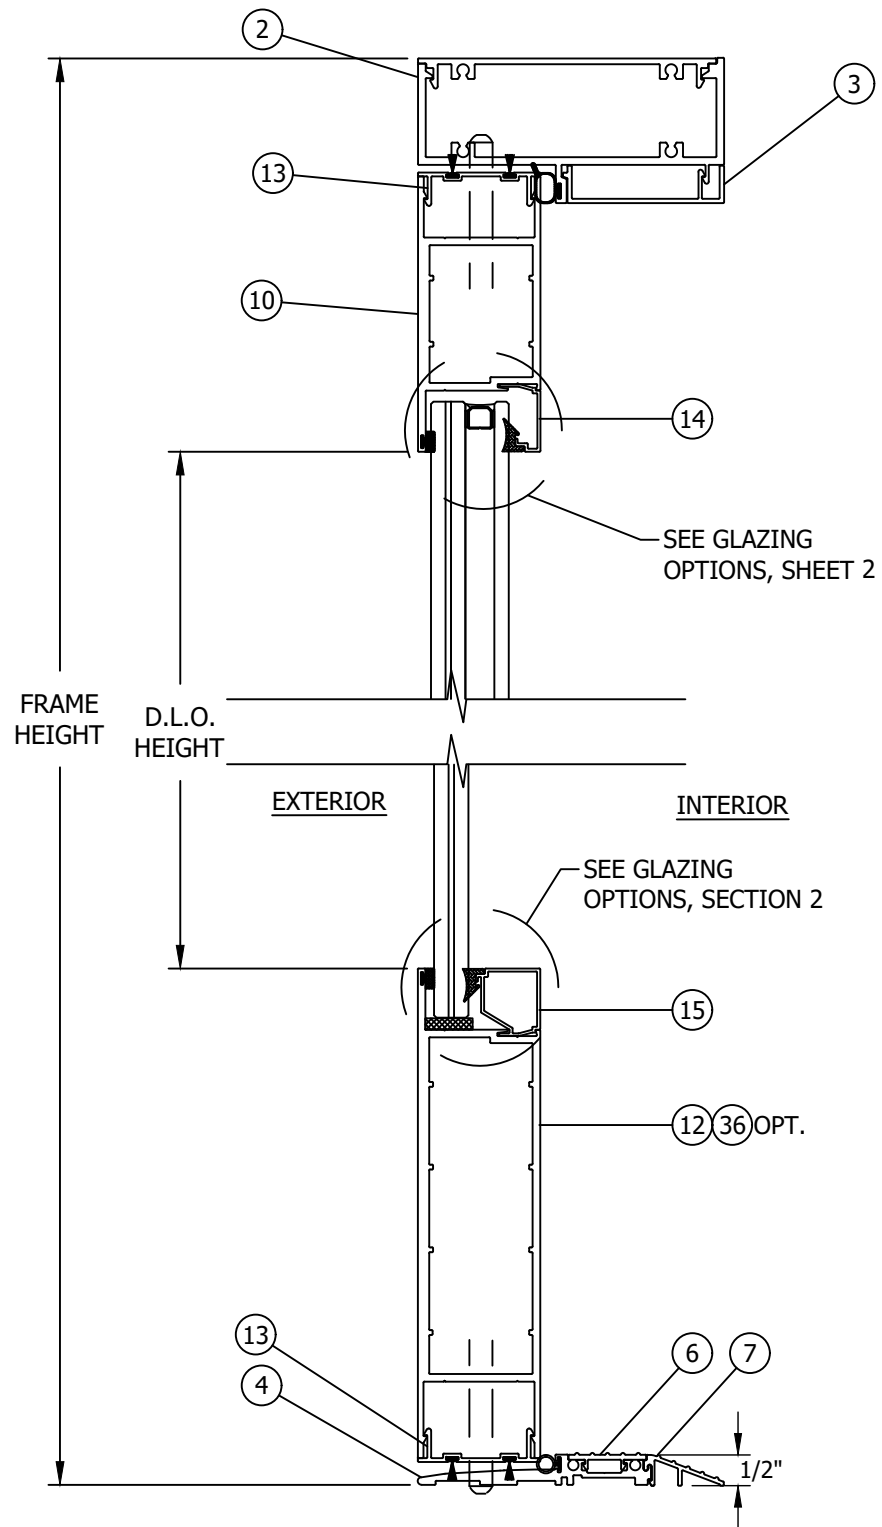

A
7 VERTICAL SECTION
HEAD - ADA SILL

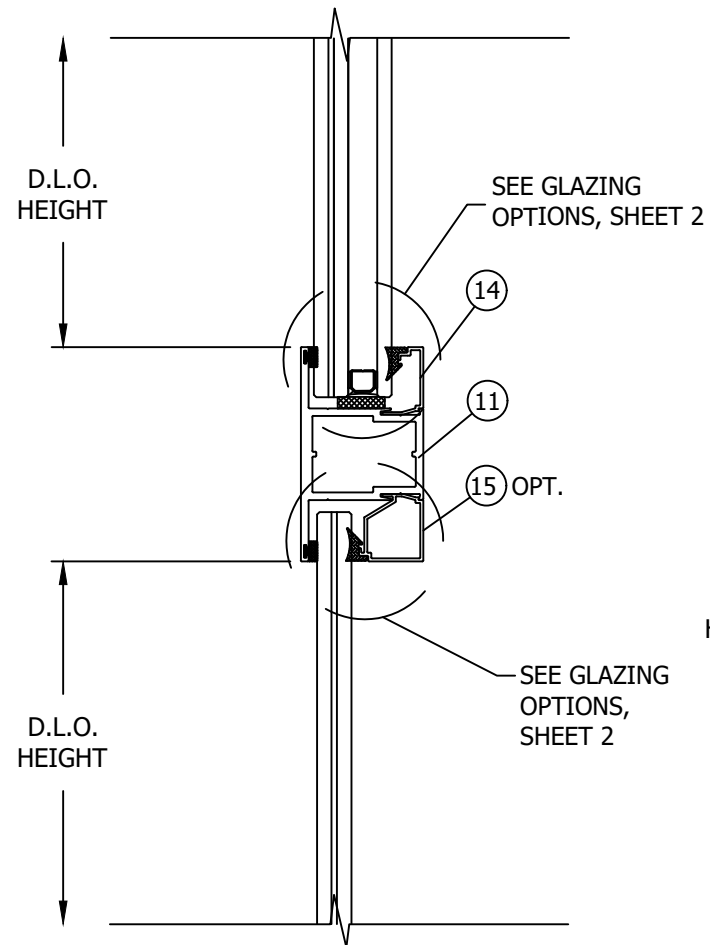

B
7 VERTICAL SECTION
MEETING RAIL
OPTIONAL

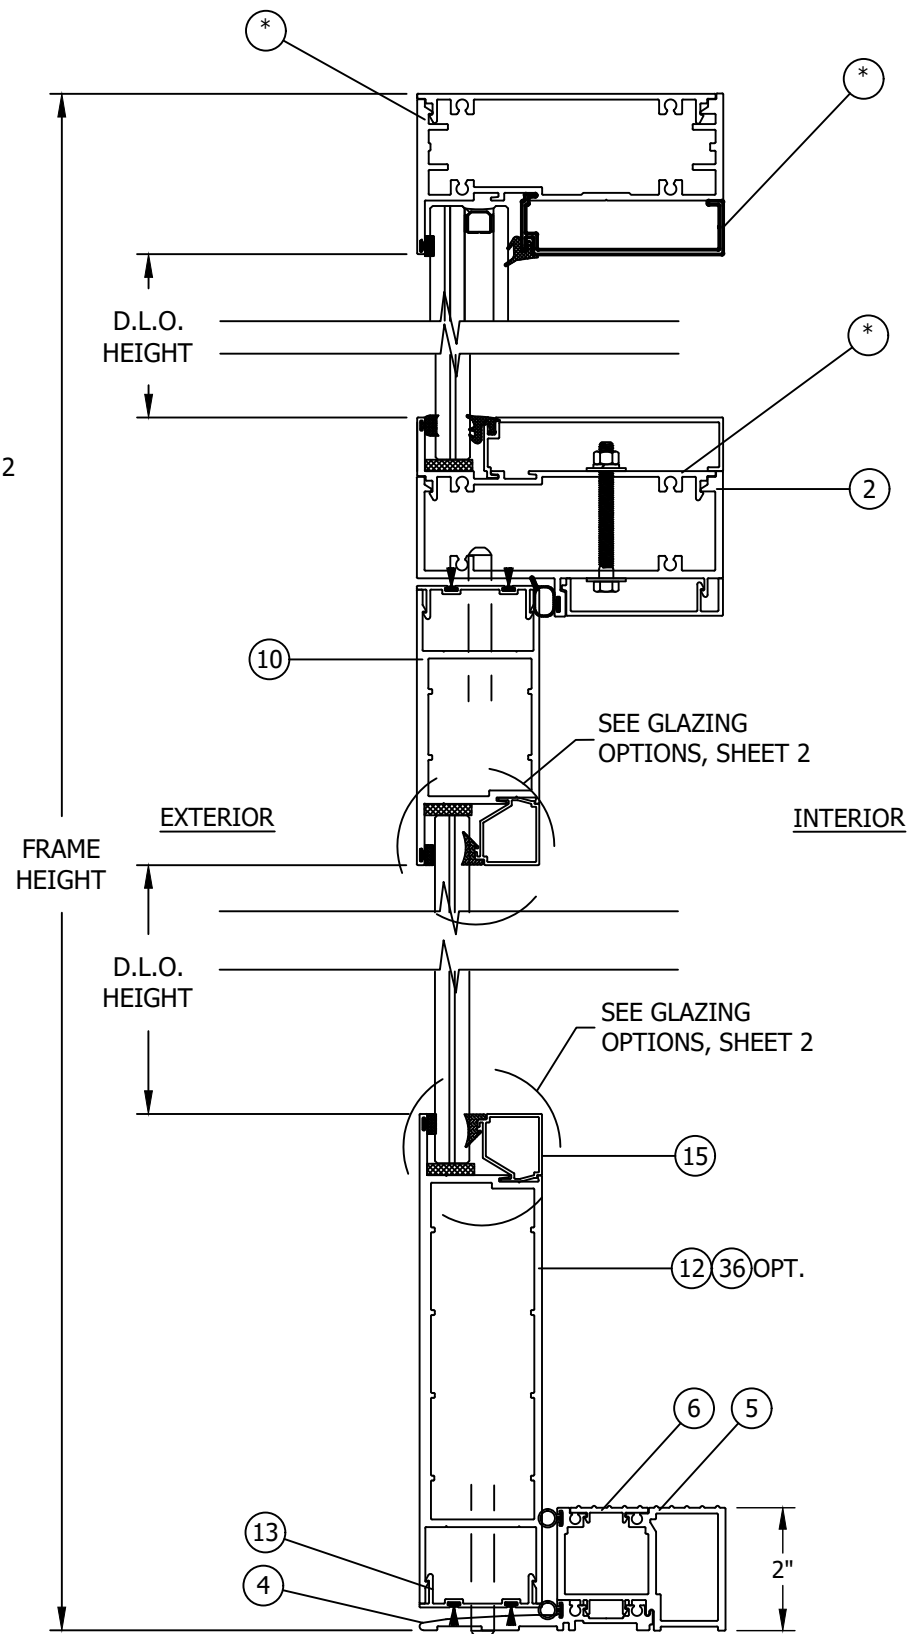

C
7 VERTICAL SECTION
HEAD W/TRANSOM- WATER SILL

* SEE SERIES 500 DETAILS UNDER SEPARATE APPROVAL



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871 FX: (305) 713-1872

TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)


VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

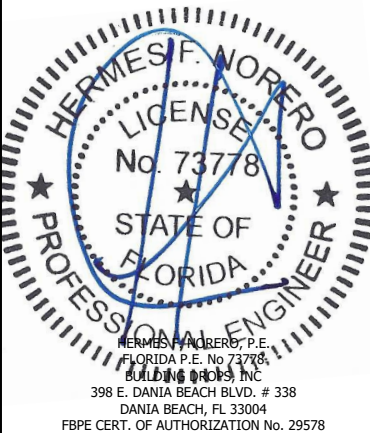

FL #:

FL38771

DATE: **06.14.21**

DWG. BY:
ER

CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **ECI030**

SHEET:

7

OF 14

s:\projects\eurocraft industries inc\bc-21-1156.1 - fbc submittal - f138771 series 600 os commercial door\dwgs\eci030.dwg
9/19/2022 3:28 PM

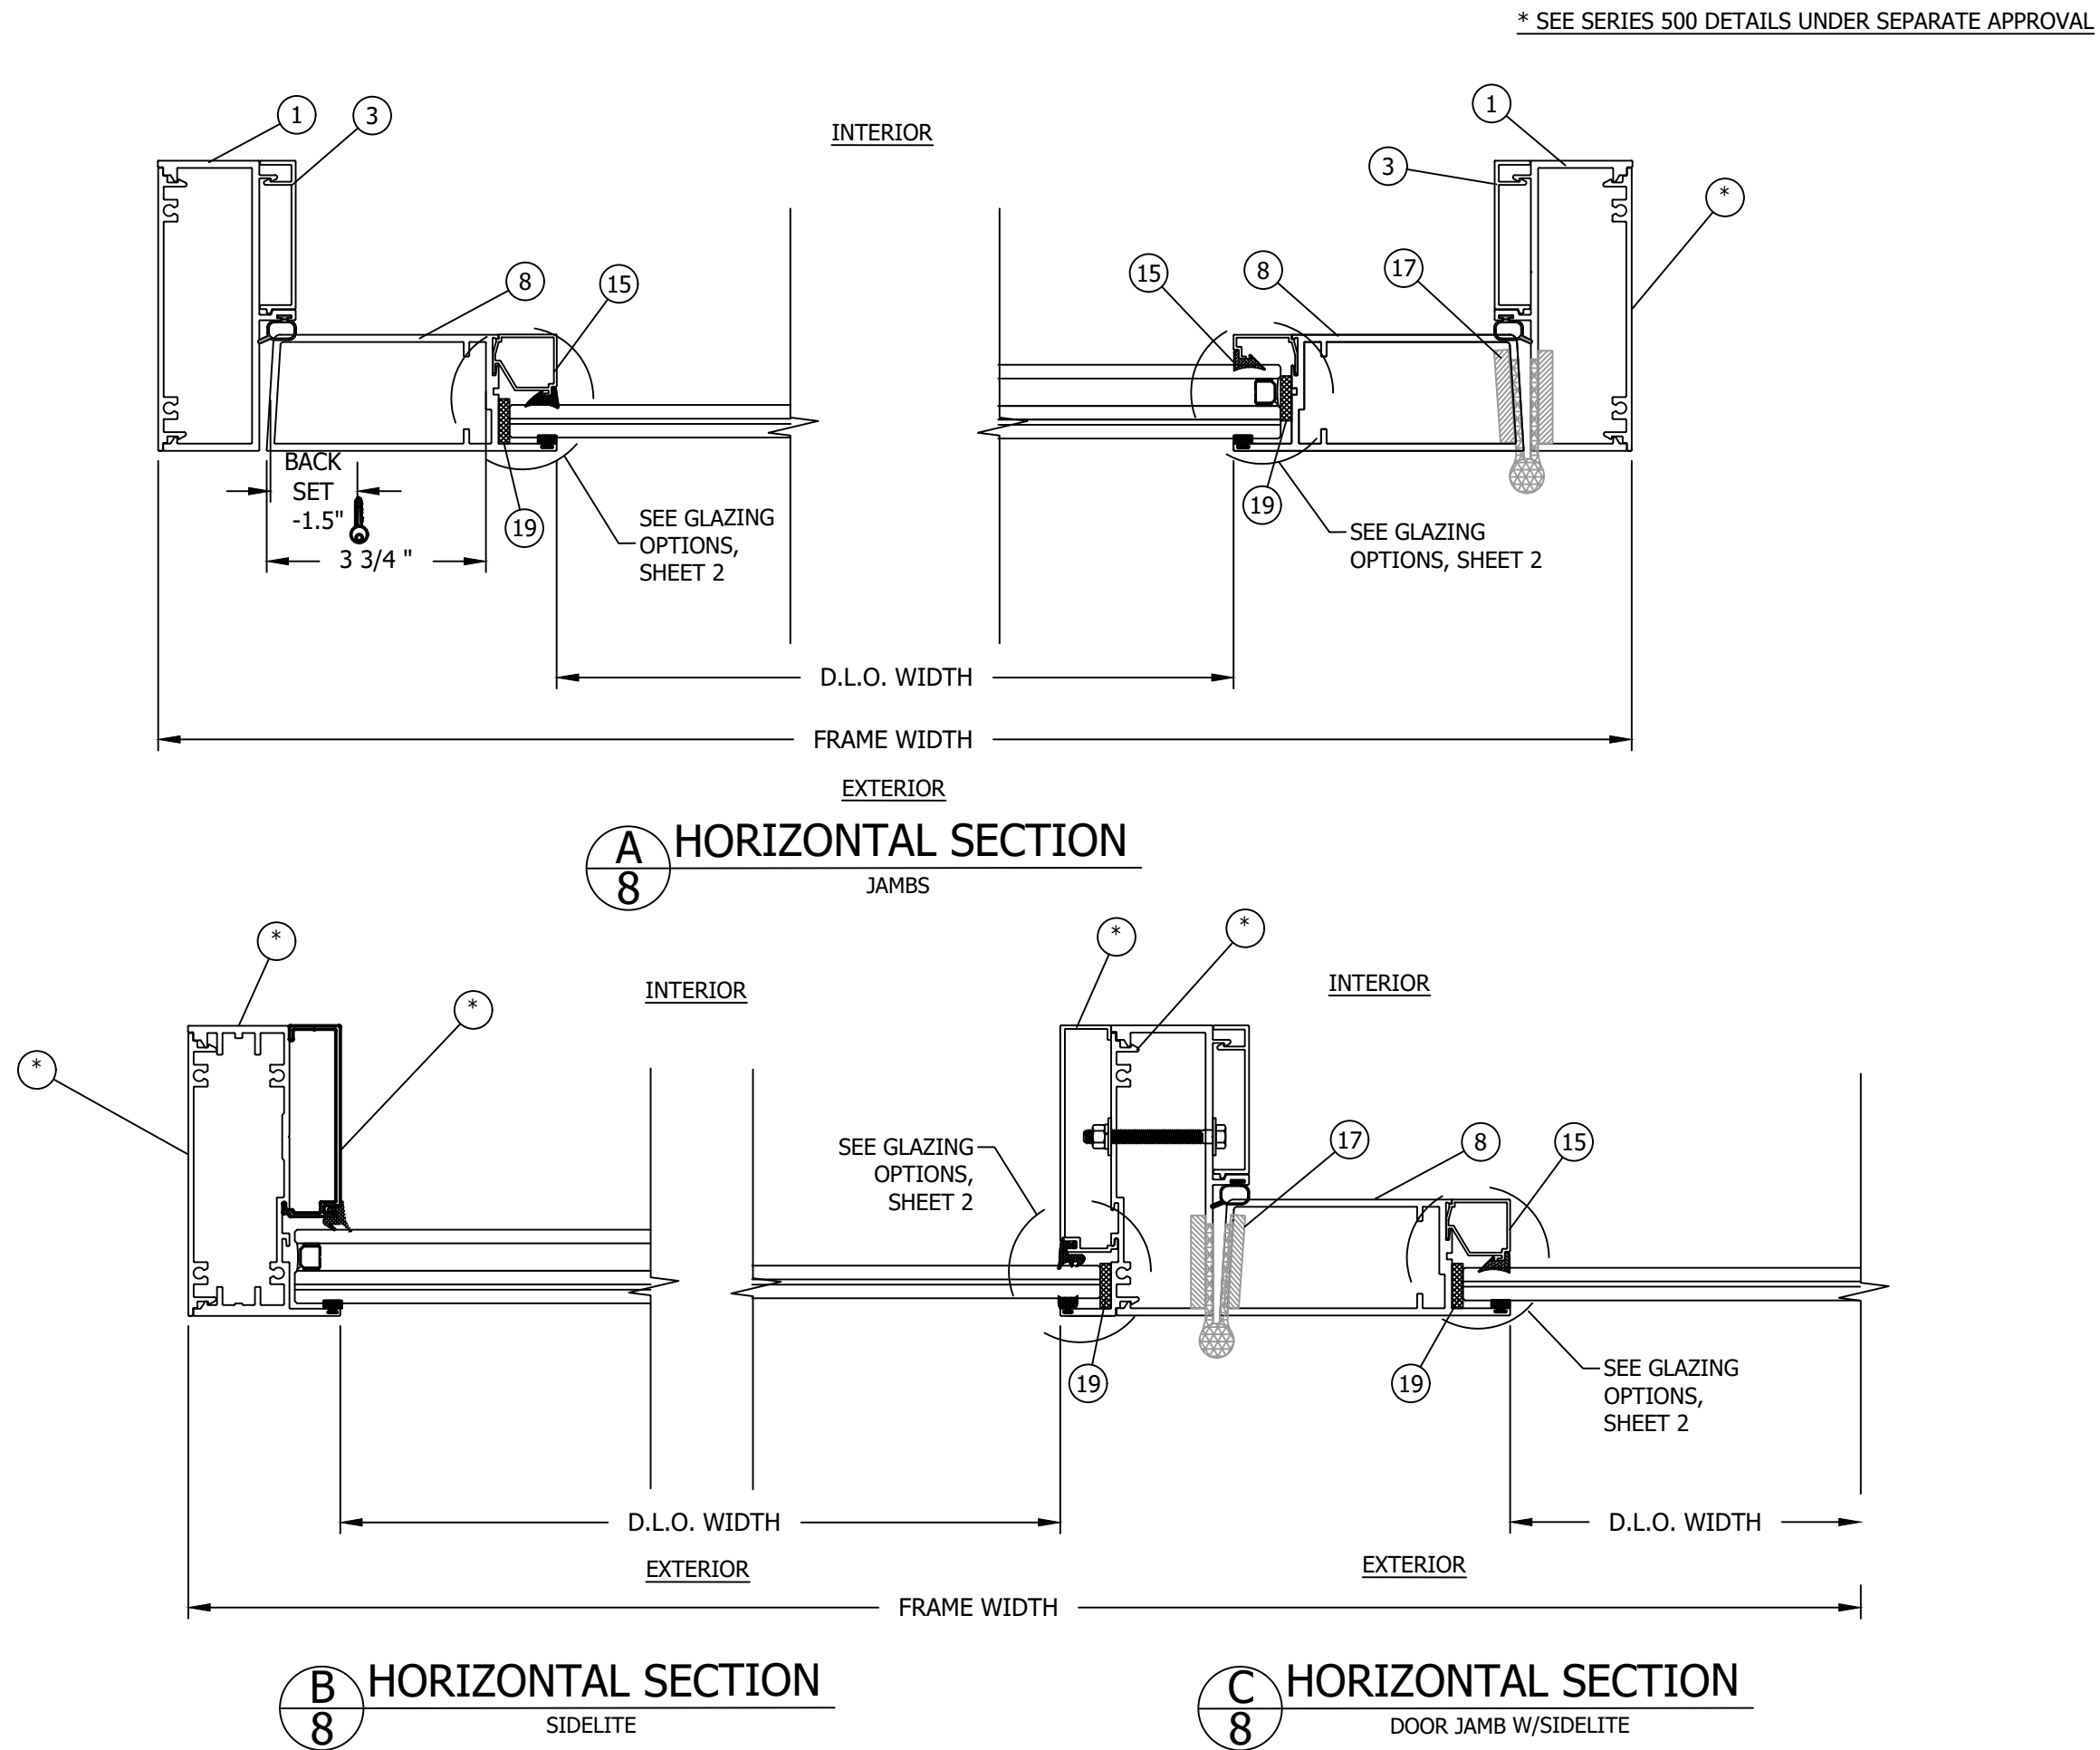

7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871FX: (305) 713-1872

TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:
 BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL38771

DATE:

06.14.21

DWG. BY:

ER

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

ECI030


SHEET:

8


OF 14

9/19/2022 3:28 PM


s:\projects\eurocraft industries inc\bc-21-1156.1 - fbc submittal - f138771-series 600 os commercial door.dwg\ec030.dwg

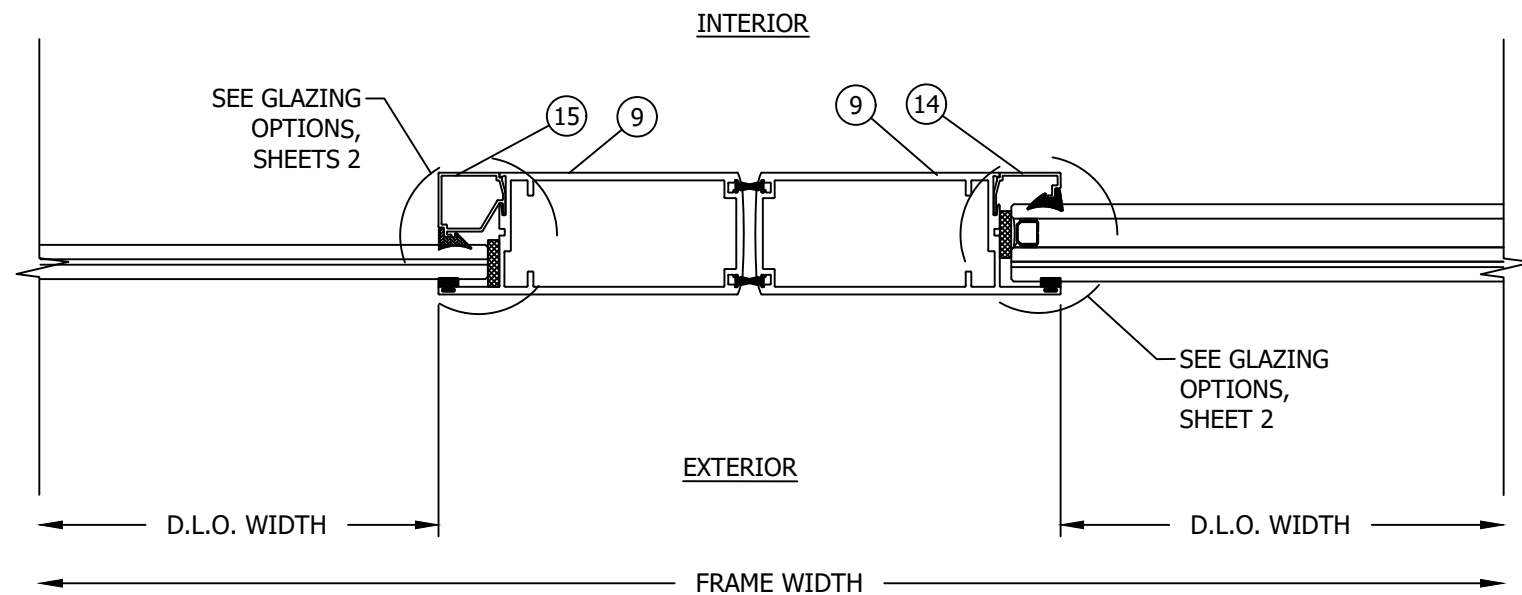


A HORIZONTAL SECTION
9 ASTRAGAL WITHOUT REINFORCEMENT DOOR HEIGHT < 96"

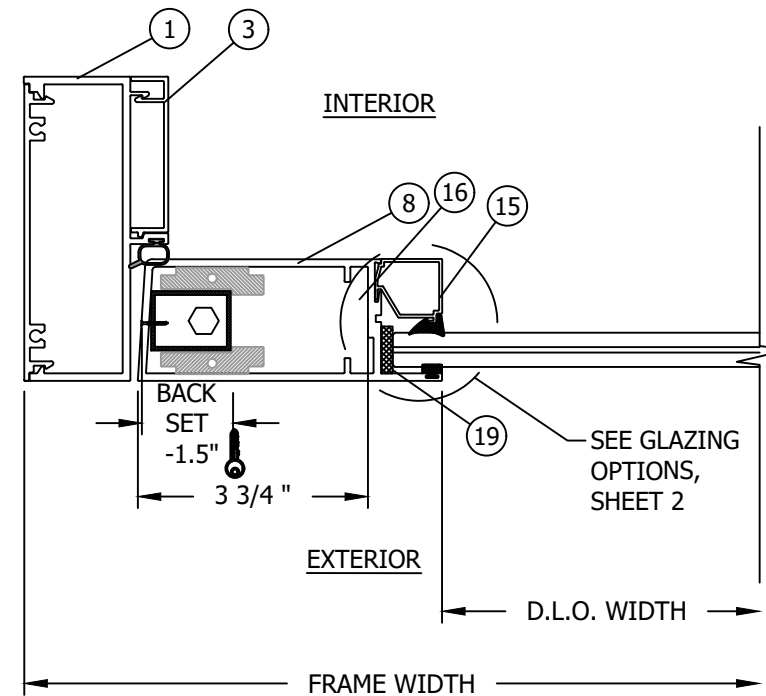

C HORIZONTAL SECTION
9 STILE REINFORCED ADAMS RITE 3 POINT LOCK

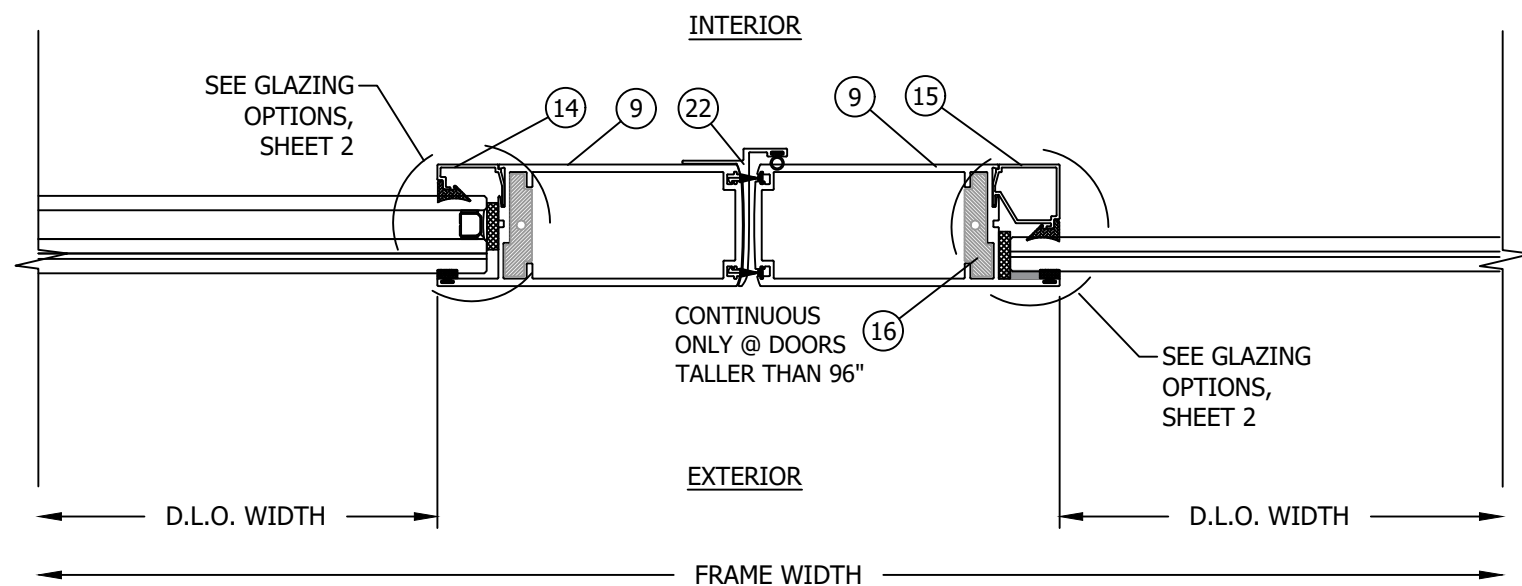

B HORIZONTAL SECTION
9 ASTRAGAL W/T REINFORCEMENT DOOR HEIGHT ≥ 96"

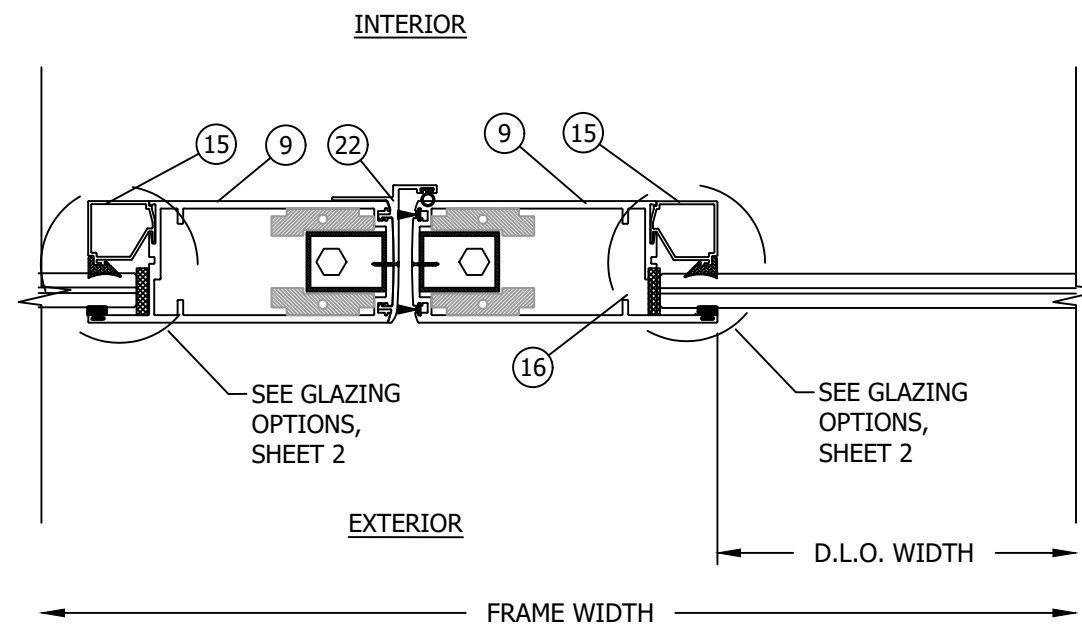

D HORIZONTAL SECTION
9 STILE REINFORCED ADAMS RITE 3 POINT LOCK



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871 FX: (305) 713-1872


TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

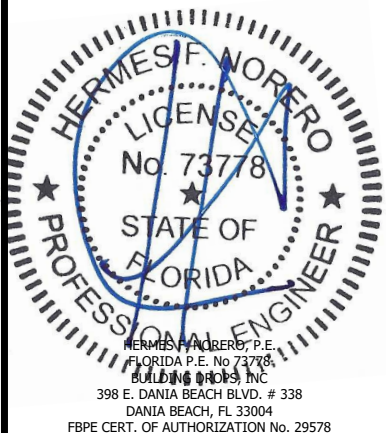


FL #:	FL38771
DATE:	06.14.21
DWG. BY:	ER
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ECI030
SHEET:	9

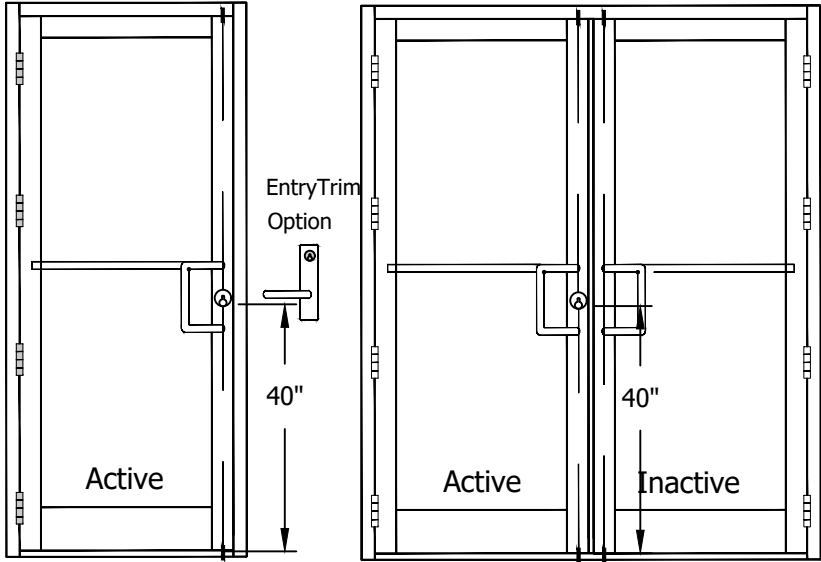

LOCK OPTION #1:

ACTIVE LEAF
3- POINT LOCK SYSTEM BY ADAMS RITE AT 40" FROM BOTTOM
HANDLE ACTIVATES DEAD BOLTS AND SHOOT BOLTS ENGAGING
AT HEAD AND SILL
KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR


INACTIVE LEAF
2- POINT LOCK SYSTEM BY ADAMS RITE AT 40" FROM BOTTOM
HANDLE ACTIVATES SHOOT BOLTS ENGAGING AT HEAD AND SILL

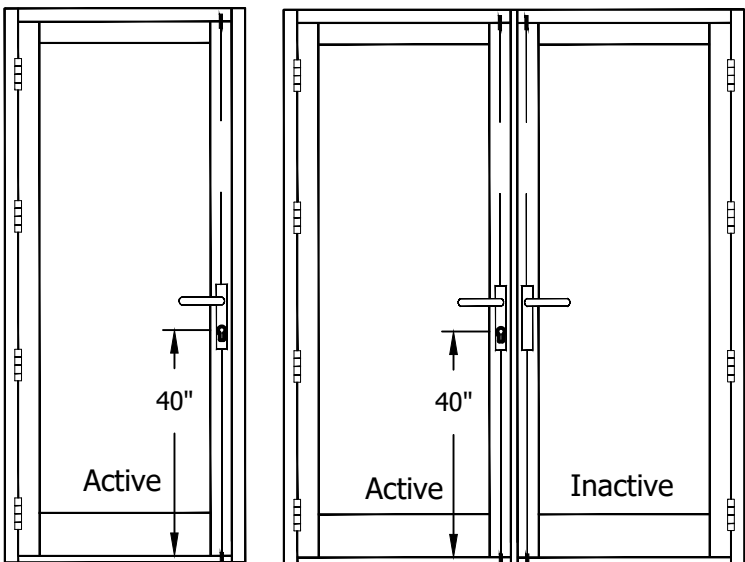

LOCK OPTION #2:


ACTIVE LEAF
3- POINT LOCK BY INTERLOCK (X3) AT 40" FROM BOTTOM
HANDLE ACTIVATES DEAD BOLTS AND SHOOT BOLTS ENGAGING
AT HEAD AND SILL
KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR

INACTIVE LEAF
2- POINT LOCK SYSTEM BY ADAMS RITE AT 40" FROM BOTTOM
HANDLE ACTIVATES SHOOT BOLTS ENGAGING AT HEAD AND SILL

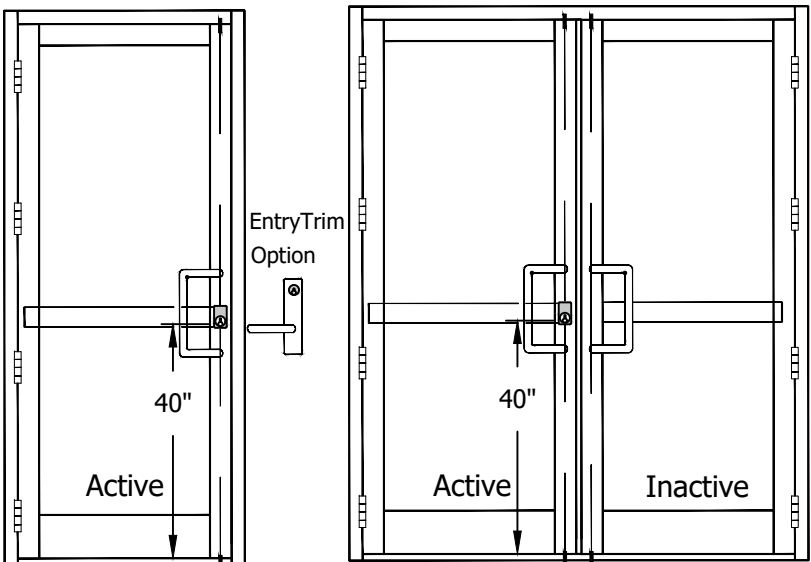


LOCK OPTION #3:

ACTIVE AND INACTIVE LEAF
CONCEALED VERTICAL ROD PANIC EXIT DEVICE BY VON DUPRIN
LOCATED AT 40" FROM SILL AT EACH LEAF

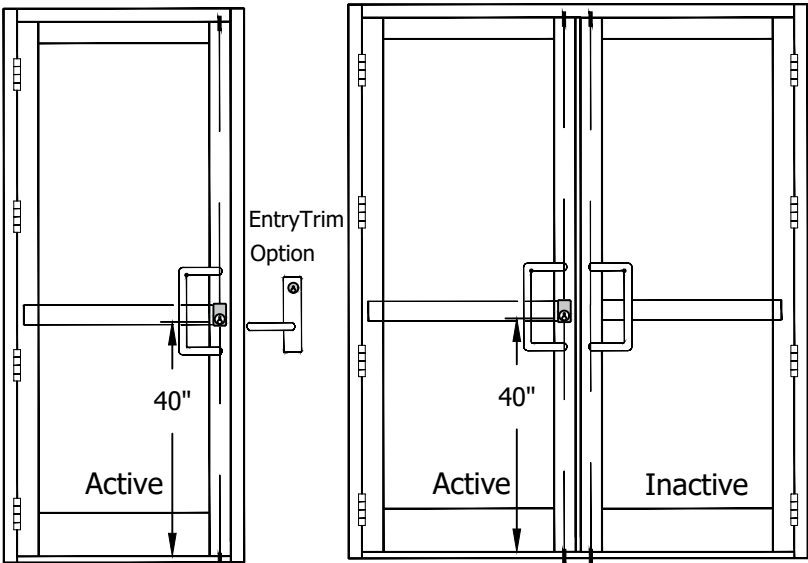


LOCK OPTION #4:

ACTIVE AND INACTIVE LEAF
CONCEALED VERTICAL ROD PANIC EXIT DEVICE BY ADAMS RIGHT
G-86 LOCATED AT 40" FROM SILL AT EACH LEAF

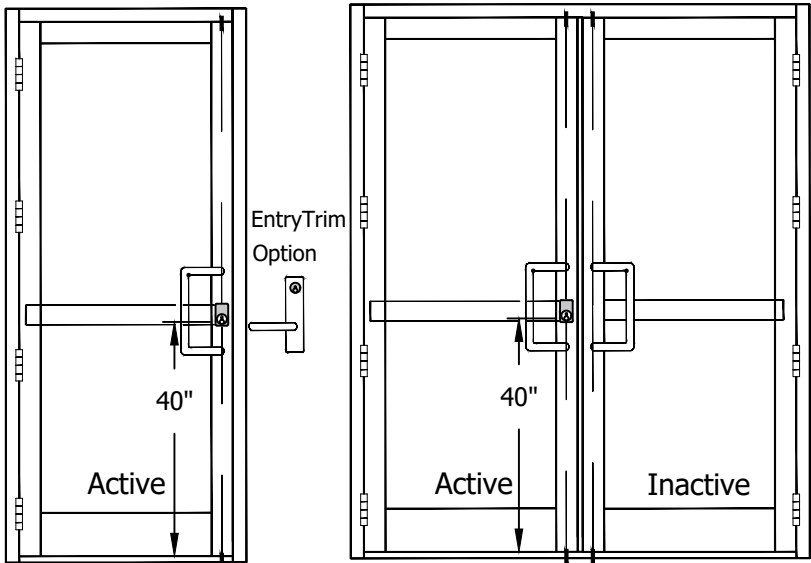

LOCK OPTION #5:
*ONLY FOR DOORS WITH HEIGHT ≤ 96"

ACTIVE AND INACTIVE LEAF
CONCEALED VERTICAL ROD PANIC EXIT DEVICE BY GAAB LOCKS
T-352 LOCATED AT 40" FROM SILL AT EACH LEAF

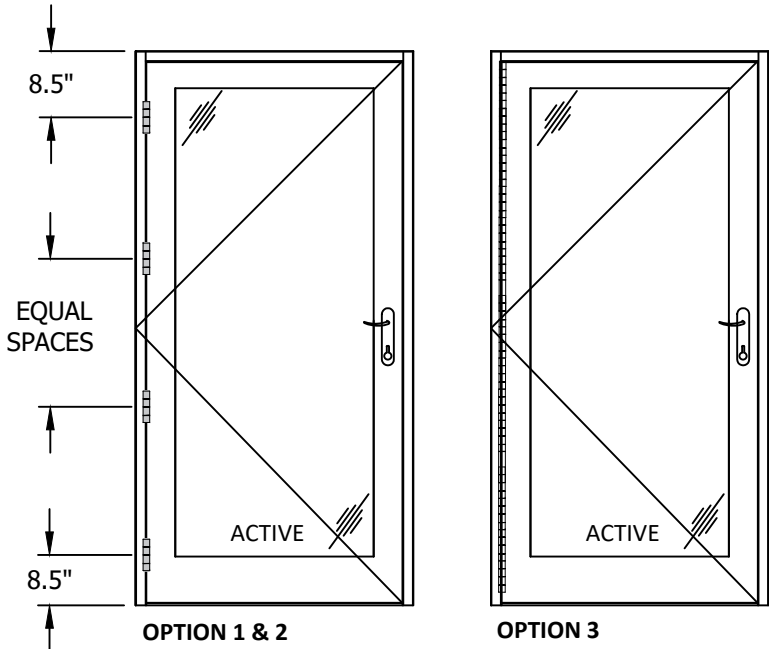

HINGE OPTIONS

HINGE OPTION #1:
BUTT HINGE BY HANGER/ IDH/ MCKINNEY (3) PER LEAF UP TO 96"
F.H. @ 8 1/2" FROM HEAD AND SILL AND (2) EQUAL SPACES.

HINGE OPTION #2:
BUTT HINGE BY HANGER/ IDH/ MCKINNEY (4) PER LEAF FROM 96"
TO 120" F.H.
@ 8 1/2" FROM HEAD AND SILL AND (3) EQUAL SPACES.

HINGE OPTION #3:
CONTINUOUS HINGE HALF MORTISE BY PEMCO



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871 FX: (305) 713-1872

TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)

HARDWARE OPTIONS


PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

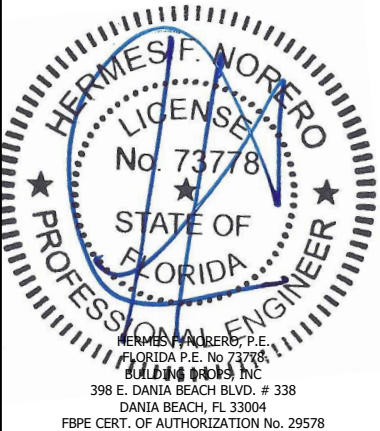

FL #:
FL38771

DATE: **06.14.21**

DWG. BY: **ER** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ECI030**




SHEET:

10

s:\projects\eurocraft industries inc\bc-21-1156.1 - fbc submittal - r138771-series 600 os commercial door.dwg\eci030.dwg 9/19/2022 3:28 PM

MULLION LOAD CAPACITY			
WIDTH (IN)	HEIGHT (IN)	"DESIGN PRESSURE (+/- PSF)"	
		REINFORCED	NON-REINFORCED
24.0	84.0	140.0	100.0
30.0		140.0	100.0
36.0		140.0	100.0
42.0		140.0	100.0
48.0		140.0	100.0
54.0		140.0	95.2
60.0		137.1	85.7
66.0		124.7	77.9
72.0		114.3	-
78.0		105.5	-
84.0		98.0	-
90.0		91.4	-
96.0		85.7	-
102.0		80.7	-
24.0	90.0	140.0	100.0
30.0		140.0	100.0
36.0		140.0	100.0
42.0		140.0	100.0
48.0		140.0	100.0
54.0		140.0	88.9
60.0		128.0	80.0
66.0		116.4	-
72.0		106.7	-
78.0		98.5	-
84.0		91.4	-
90.0		85.3	-
96.0		80.0	-
102.0		75.0	-
24.0	96.0	140.0	100.0
30.0		140.0	100.0
36.0		140.0	100.0
42.0		140.0	100.0
48.0		140.0	93.8
54.0		133.3	83.3
60.0		120.0	75.0
66.0		109.1	-
72.0		100.0	-
78.0		92.3	-
84.0		85.7	-
90.0		80.0	-
96.0		75.0	-
102.0		70.0	-
24.0	102.0	120.0	100.0
30.0		120.0	100.0
36.0		120.0	100.0
42.0		120.0	100.0
48.0		120.0	88.2
54.0		120.0	78.4
60.0		112.9	-
66.0		102.7	-
72.0		94.1	-
78.0		86.9	-
84.0		80.7	-
90.0		75.0	-
96.0		70.0	-
102.0		65.0	-
24.0	108.0	120.0	100.0
30.0		120.0	100.0
36.0		120.0	100.0
42.0		120.0	95.2
48.0		120.0	83.3
54.0		118.5	-
60.0		106.7	-
66.0		97.0	-
72.0		88.9	-
78.0		82.1	-

MULLION LOAD CAPACITY			
WIDTH (IN)	HEIGHT (IN)	"DESIGN PRESSURE (+/- PSF)"	
		REINFORCED	NON-REINFORCED
24.0	114.0	120.0	100.0
30.0		120.0	100.0
36.0		120.0	100.0
42.0		120.0	90.2
48.0		120.0	78.9
54.0		112.3	-
60.0		101.1	-
66.0		91.9	-
72.0		84.2	-
78.0		77.0	-
24.0	120.0	120.0	100.0
30.0		120.0	100.0
36.0		120.0	95.6
42.0		120.0	81.9
48.0		120.0	71.7
54.0		106.7	-
60.0		96.0	-
66.0		87.3	-
72.0	126.0	80.0	-
78.0		72.0	-
84.0		64.0	-
90.0		56.0	-
96.0		48.0	-
102.0		40.0	-
108.0		32.0	-
114.0		24.0	-
24.0	132.0	120.0	100.0
30.0		120.0	86.2
36.0		120.0	71.8
42.0		103.0	61.5
48.0		90.2	-
54.0		80.1	-
60.0		72.1	-
66.0		64.1	-
72.0	138.0	120.0	94.3
78.0		120.0	75.4
84.0		105.2	62.8
90.0		90.2	-
96.0		78.9	-
102.0		70.1	-
108.0		63.1	-
114.0		56.1	-
24.0	144.0	120.0	83.0
30.0		111.1	66.4
36.0		92.6	55.3
42.0		79.4	-
48.0		69.4	-
54.0		61.7	-
60.0		55.6	-
66.0		50.0	-

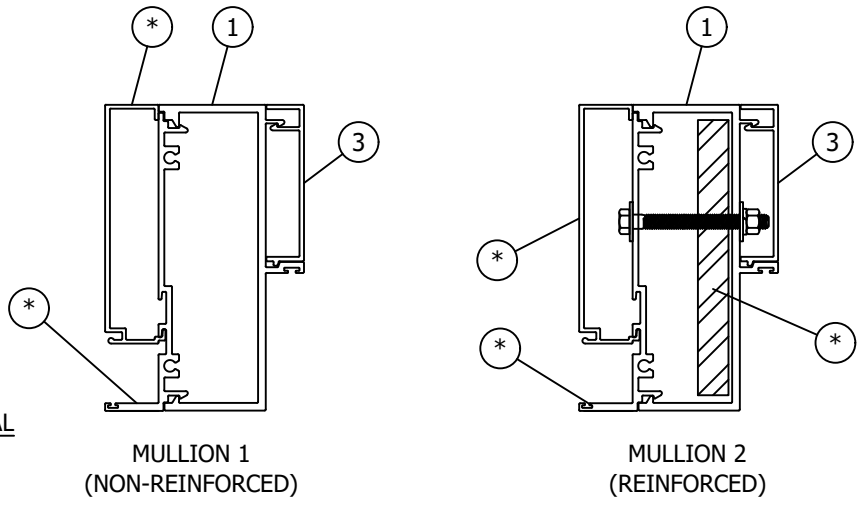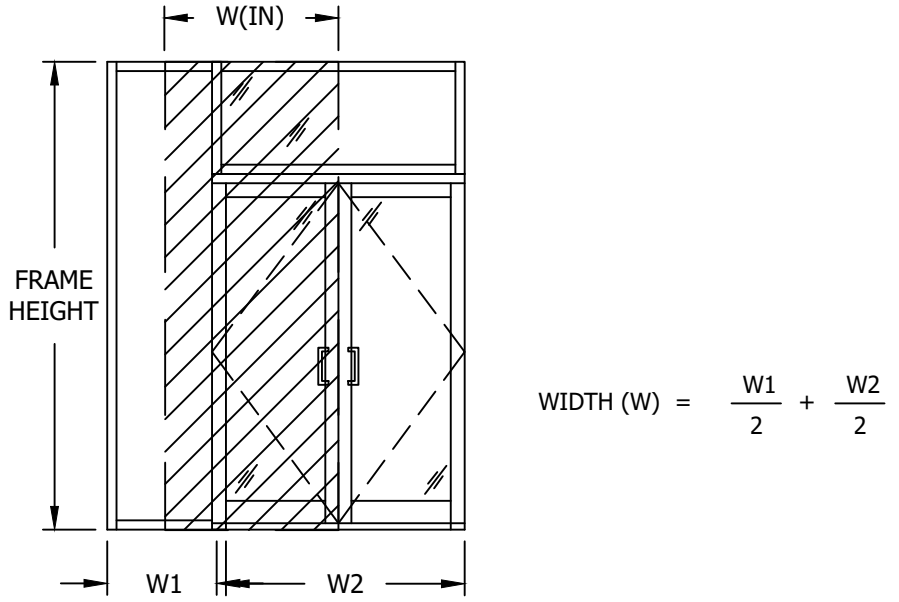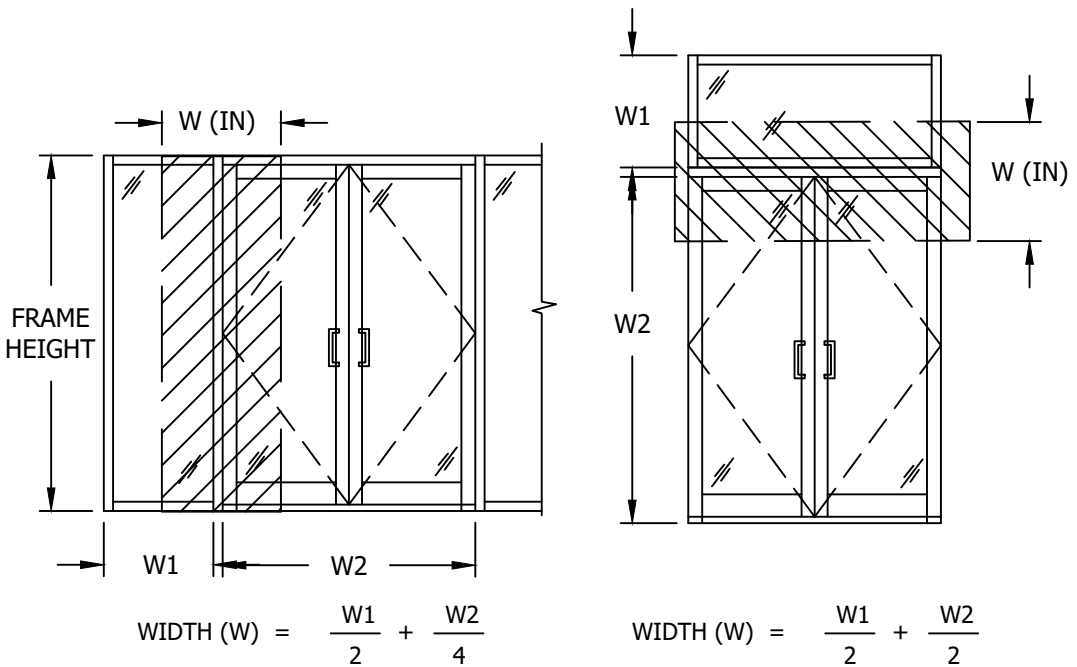

* SEE SERIES 500 DETAILS UNDER SEPARATE APPROVAL



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871 FX: (305) 713-1872

TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)

MULLION LOAD JAMB CAPACITY

PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004


PH: (954)399-8478
FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

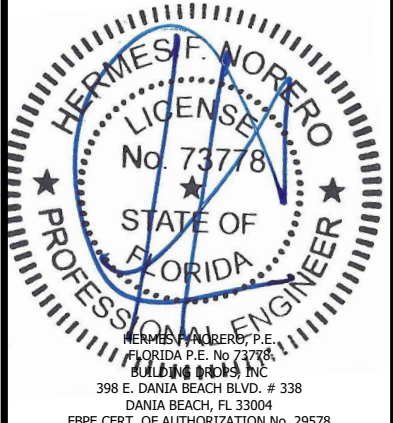

FL #:

FL38771

DATE: **06.14.21**

DWG. BY: **ER** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ECI030**


SHEET:

11

OF 14

s:\projects\eurocraft industries inc\bc-21-1156.1 - fbc submittal - f138771-series 600 os commercial door.dwg\ec030.dwg 9/19/2022 3:28 PM

INTERIOR

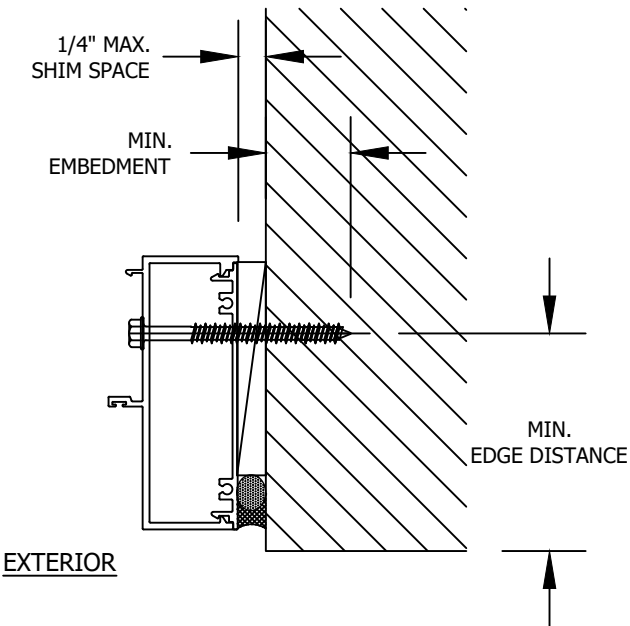


EXTERIOR

EXTERIOR

A
12

JAMB SECTION

THROUGH FRAME

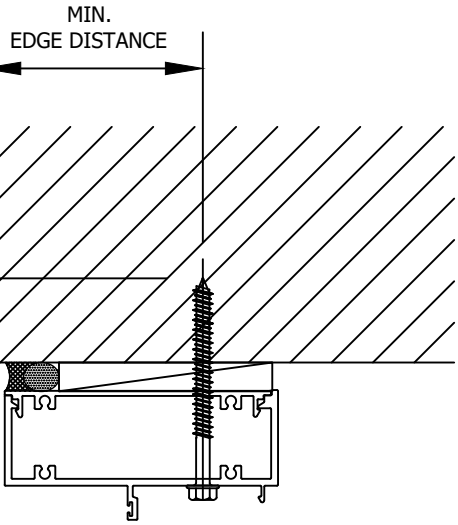


INTERIOR

B
12

HEAD SECTION

THROUGH FRAME

EXTERIOR

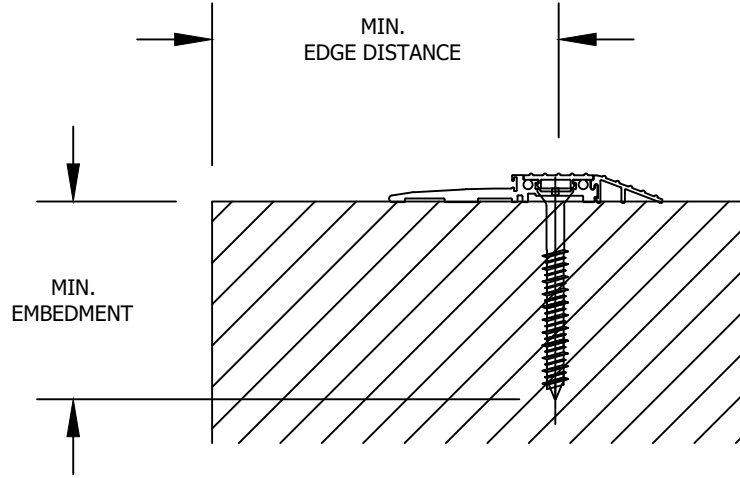

INTERIOR

C
12

THRESHOLD SECTION

THROUGH FRAME

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE					
METHOD	ANCHOR TYPE	SUBSTRATE	ANCHOR SCHEDULE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	A	2XWOOD: MIN. SG= 0.55	5/16" ULTRACON	1.5"	1.5"
	B	METAL: 18 GAUGE STEEL, MIN. FY= 33KSI	5/16" SMS OR SELF DRILLING SCREW	1.75"	2.5"
	C	METAL: ALUMINUM MIN. 1/8" THICKNESS (6063-T5 MIN.)			
	D	CONCRETE: MIN. F'C= 3000 PSI OR MASONRY: CMU PER ASTM C90 MIN. 2000 PSI	5/16" ULTRACON	1.75"	2.5"



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871FX: (305) 713-1872

TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)

INSTALLATION NOTES &
ANCHOR DETAILS

PREPARED BY:




BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

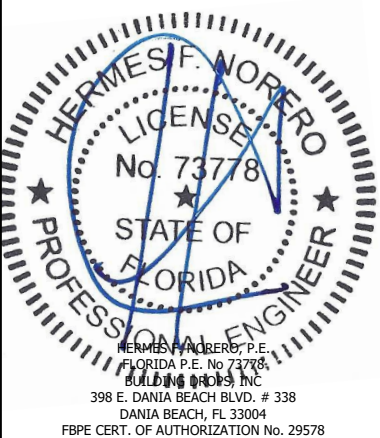

FL #:

FL38771

DATE: 06.14.21

DWG. BY:
ER

CHK. BY:
HFN

SCALE: NTS

DWG. #: ECI030

SHEET:

12

OF 14

9/19/2022 3:28 PM

s:\projects\eurocraft industries inc\bc-21-1156.1 - fbc submittal - f138771-series 600 os commercial door.dwg\eci030.dwg

BILL OF MATERIALS				
ITEM #	PART NO.	DESCRIPTION	MATERIAL	MANUFACTURER
1	600-01	JAMBS	6063-T6	EUROCRAFT
2	600-02	HEAD	6063-T6	EUROCRAFT
3	600-03	FRAME COVER	6063-T6	EUROCRAFT
4	600-04	TRHESHOLD	6063-T6	EUROCRAFT
5	600-05	THRESHOLD ADAPTER	6063-T6	EUROCRAFT
6	600-06	THRESHOLD COVER	6063-T6	EUROCRAFT
7	600-07	RAMP	6063-T6	EUROCRAFT
8	600-09	DOOR STILE	6063-T6	EUROCRAFT
9	600-10	DOOR STILE	6063-T6	EUROCRAFT
10	600-11	TOP RAIL	6063-T6	EUROCRAFT
11	600-12	MEETING RAIL	6063-T6	EUROCRAFT
12	600-13	BOTTOM RAIL 8"	6063-T6	EUROCRAFT
13	600-15	RAIL COVER	6063-T6	EUROCRAFT
14	600-16	IG- GLAZING BEAD	6063-T6	EUROCRAFT
15	600-17	LAMINATED- GLAZING BEAD	6063-T6	EUROCRAFT
16	600-18	ASTRAGAL REINFORCEMENT	6063-T6	EUROCRAFT
17	600-19	HINGE REINFORCEMENT	6063-T5	EUROCRAFT
18	600-08	SHEAR BLOCK	6063-T5	EUROCRAFT
19		SETTING BLOCK	TPV	EXTRUSIONES, MPI
20		GASKET	EPDM, TPV	
21		GASKET	EPDM, TPV	EXTRUSIONES, MPI
22	600-14	ASTRAGAL ADAPTER	6063-T6	EUROCRAFT
23		BUTL HINGES		BY IDH
24		BUTL HINGES		BY MCKINNEY
25		CONTINUOUS HINGES		BY PEMKO
26		CONTINUOUS HINGES		BY ABH
27		ASSEMBLING SCREW #12 x 1.5 STAINLESS STEEL	STAINLESS STEEL	
28		ASSEMBLING SCREW #12 X 0.75	STAINLESS STEEL	
29		ASSEMBLING SCREW THRESHOLD #10 x 1.5	STAINLESS STEEL	
30		THREE POINT LOCK		ADAMS RITE
31		THREE POINT LOCK BY INTERLOCK		INTERLOCK
32		CONCEAL VERTICAL ROD PANIC DEVICE G-86		ADAM RITE
33		PILE WEATHERSEALS ULTRAFAB		ULTRA FAB
34		1/4" x 2" BOLT AND NUT		
35		CONCEAL VERTICAL ROD PANIC DEVICE SERIES 98 / 99		VON DUPRIN
36	600-20	BOTTOM RAIL 10"		EUROCRAFT
37		CONCEAL VERTICAL ROD PANIC DEVICE T-352		GAAB LOCKS



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871FX: (305) 713-1872

TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)

BILL OF MATERIALS

PREPARED BY:

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338

DANIA BEACH, FL 33004

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

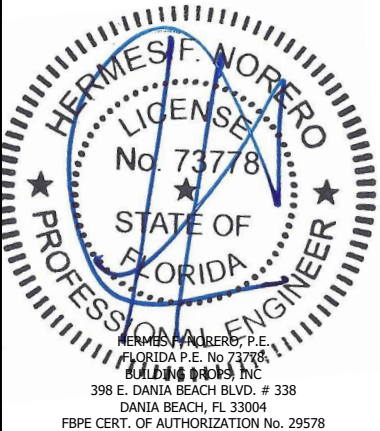

FL #:
FL38771

DATE: **06.14.21**

DWG. BY: ER	CHK. BY: HFN
-----------------------	------------------------


SCALE: **NTS**

DWG. #: **ECI030**


SHEET:
13
OF 14

s:\projects\eurocraft industries inc\bc-21-1156.1 - fbc submittal - r138771 series 600 os commercial door.dwg\eci030.dwg
9/19/2022 3:28 PM


1 600-01 - JAMB

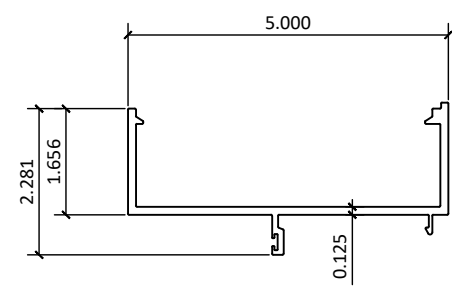


2 600-02 - HEAD

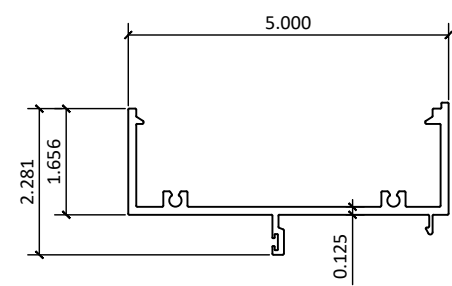


3 600-03 - FRAME COVER




4 600-04 - THRESHOLD

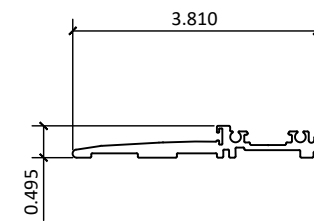


5 600-05 - THRESHOLD ADAPTER

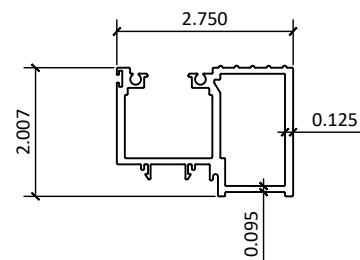


6 600-06 - THRESHOLD COVER




7 600-07 - RAMP




8 600-09 - DOOR STILE

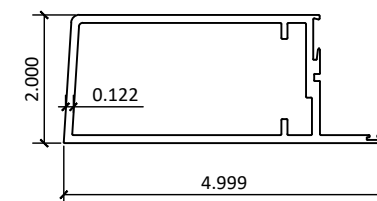


9 600-10 - DOOR STILE

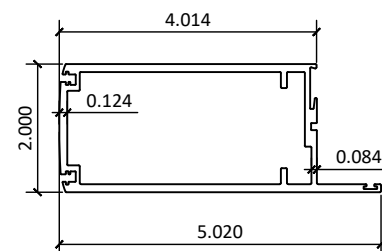


10 600-11 - TOP RAIL

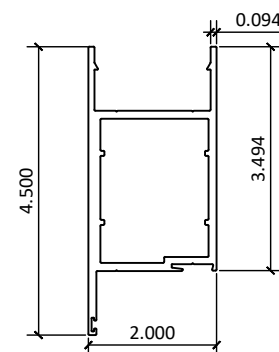


11 600-12 - MEETING RAIL - OPTIONAL




12 600-13 - BOTTOM RAIL 8"

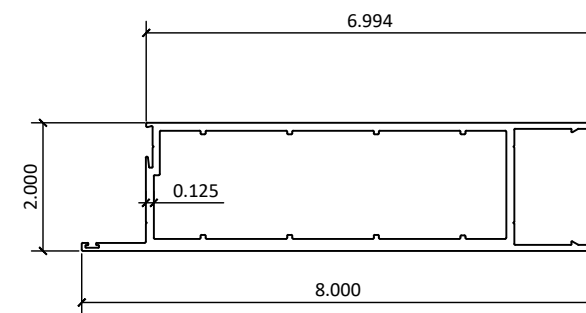


13 600-15 - RAIL COVER




14 600-16 - IG GLAZING BEAD




15 600-17 - LAM. GLAZING BEAD




16 600-18 - ASTRAGAL REINFORCEMENT




36 600-20 - BOTTOM RAIL 10" OPTIONAL

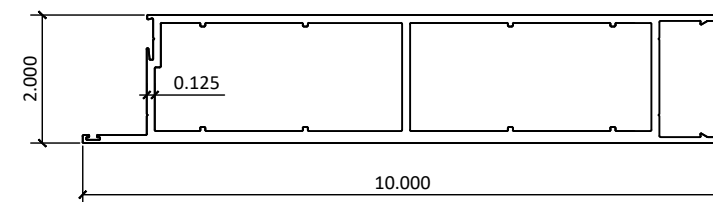


17 600-19 - HINGE REINFORCEMENT



18 600-08 - SHEAR BLOCK



19 600-14 - ASTRAGAL ADAPTER



7905 NW 77TH AVE
MEDLEY, FL 33166
PH: (305) 713-1871FX: (305) 713-1872

TITLE: SERIES 600 OUTSWING
COMMERCIAL DOOR
(HVHZ)(IMPACT)

COMPONENTS

PREPARED BY:




BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
HARDWARE UPDATES	SH	9.19.22

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

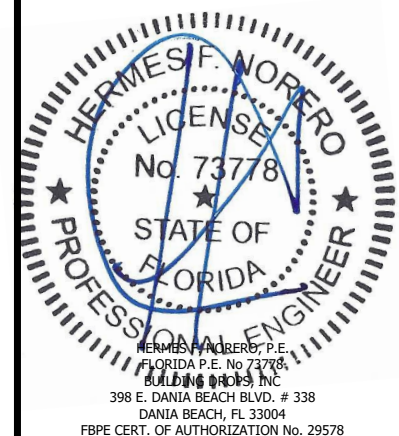

FL #:
FL38771

DATE: **06.14.21**

DWG. BY: ER	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **ECI030**

SHEET:

14

OF 14